7338 LITTLE MOUNTAIN ROAD MENTOR OHIO 44060
216-974-0555
FAX 974-5054

AZTECH
ENGINEERING and SURVEYING
Civil Engineering · Land Surveying

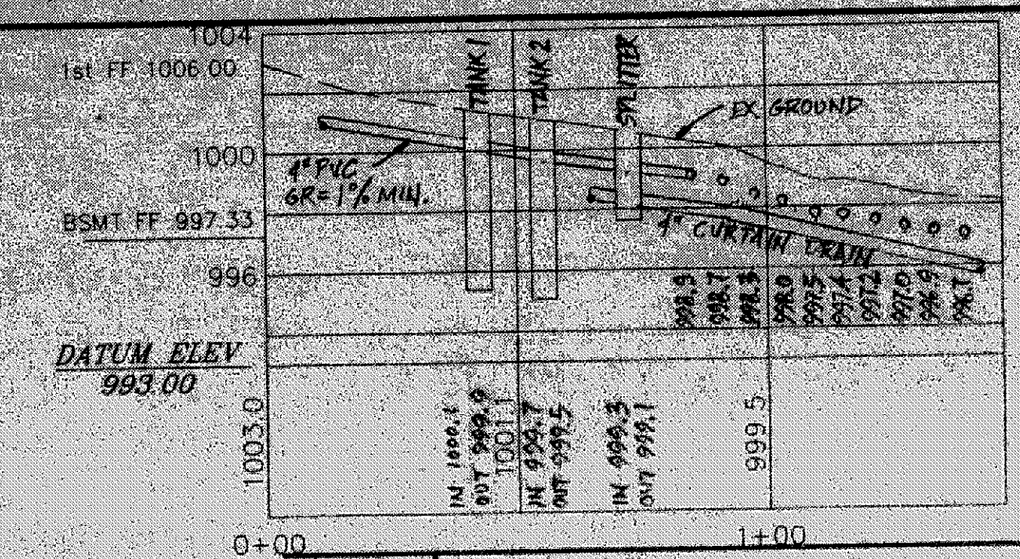

SEPTIC PROFILE
HOR. SCALE: 1" = 30'
VERT. SCALE: 1" = 5'

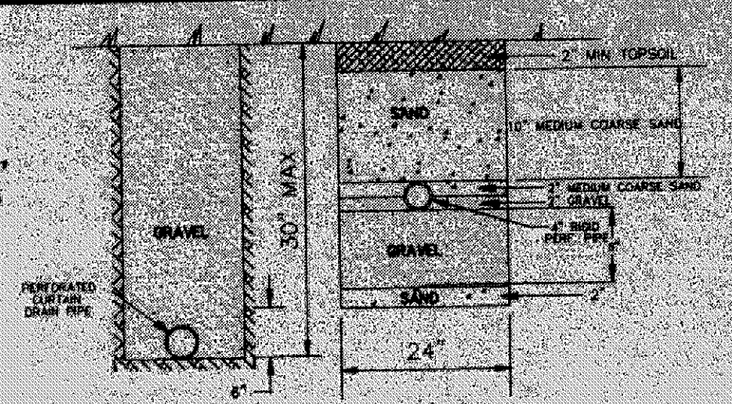

TRENCH DETAIL
NOT TO SCALE

REVISIONS: 10/24/95
PER COUNTY REVIEW
BY SRL/JFT

"I, the undersigned hereby certify that this topography, indicated by 6', 1' or 2' contours, and elevations shown hereon represent an actual survey field survey made by me on the 1st day of Nov. 1994 and that the elevations were taken at appropriate intervals and that as of that date they existed as indicated hereon."

JF Topolski — PE 44513
Name — Reg.#

STATE OF OHIO
JOHN F. TOPOLSKI
44513
REGISTERED PROFESSIONAL ENGINEER

GIRDLED ROAD 60'

S 27°12'00" E

J & D KNIERIM
P. #12

BENCHMARK
HUB SETUP
ELEV. = 1000.1

Reviewed and Accepted
LAKE COUNTY GENERAL HEALTH DISTRICT
Date 10-25-95
JOEL LUCIA, R. S., M. P. H.
Health Commissioner
By Gerald Mc

N 64°12'00" E
110.00'
396.75'

EX. HSE
F.FL 1006.3

1004.30
1004.20

30.01' I.P. FND.

EX. 18" CONC. CULVERT

S 64°22'01" W
239.20'

1004.6
1003.3
1002.1

C OF EX. DITCH

END OF ASPHALT
BEG OF GRAVEL

SPLITTER BOX

2-1000 GAL SEPTIC TANKS

1003.70
1003.80

18' CONC DRIVE 1%
1%

GRG 34'
1004.0
24.33'
11.67'
2'
13.83'

PROP HSE
F.FL
1006.0
BSMT
997.33

PROP 30'-18" CMP CULV
75' SETBACK

PROPOSED WELL

37 S.Y.

CURTAIN DRAIN 4 SIDES

EX BARN

10 LINES @ 120' EACH
(1200 LF E.V.T. LINE)

DUPLICATION AREA

530.00'
S 32°25'00" E

24' GRAVEL ROAD

C DITCH TYP.

FIELD WATER FIXTURES REQUIRED ON ALL:
Shower Head

A. To be brought to finished grade
1. Septic tank manhole covers
2. Splitter box cover
3. Distribution box cover
B. No roof drains or downspouts to ditch or to be discharged into septic system
C. All waste water to be discharged into septic tank

SEWAGE DISPOSAL PERMIT MUST BE OBTAINED BY A LAKE COUNTY LICENSED INSTALLER BEFORE INSTALLATION IS STARTED.

Certified Plan
Submitted on behalf of
THOMAS P. GILLESPIE
Lake County Engineer
By GJH Date 10/25/95

MINIMUM 3' ASPHALT APRON

VACANT LOT
ROSE GOERRA
V. 132 P. 142

GRAPHIC SCALE
(IN FEET)
1 inch = 30 ft.

SITE PLAN FOR: AUBURN CAREER CENTER
BEING 10995 GIRDLED ROAD
TOWNSHIP OF CONCORD, COUNTY OF LAKE
STATE OF OHIO

DRAWN BY: SRL	DATE: 10/18/95
CHECKED BY: JFT	DRAWING NO.: AZT-150
95179	SHEET 1 OF 1