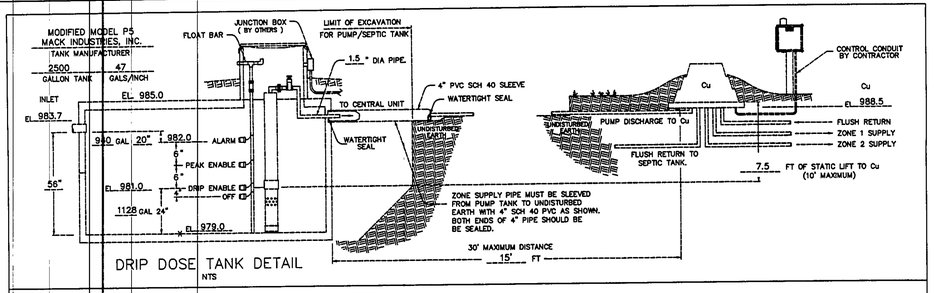

DRIP DOSE TANK DETAIL
NTS

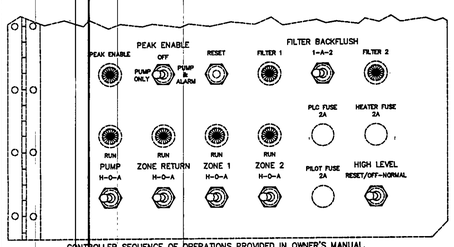

CONTROLLER SEQUENCE OF OPERATIONS PROVIDED IN OWNER'S MANUAL.

INNER DOOR LAYOUT

AMERICAN MANUFACTURING CO.
5517 WELLINGTON RD. GAINESVILLE VA 20155; 703-754-0077

PROJECT NAME:	DR. BY:	DATE:
	CK. BY:	DATE:
	APP. BY:	DATE:
COUNTY:	TITLE: Pump and Control Detail	
REV.	FILE:	SCALE: SHEET OF

AERMOTOR MODEL: TEP20-50-115

1.25" DISCHARGE
0.5 HORSEPOWER
115 VOLT
12.0 AMPS

1/16" MAX. SOLIDS HANDLING
1 PHASE
60 HZ

MULTI-STAGE CENTRIFUGAL

DOSING CHAMBER DETAIL
FOR 15 GPM AMERICAN LAMINAR FLOW COLLAR
(LFC15)
NTS

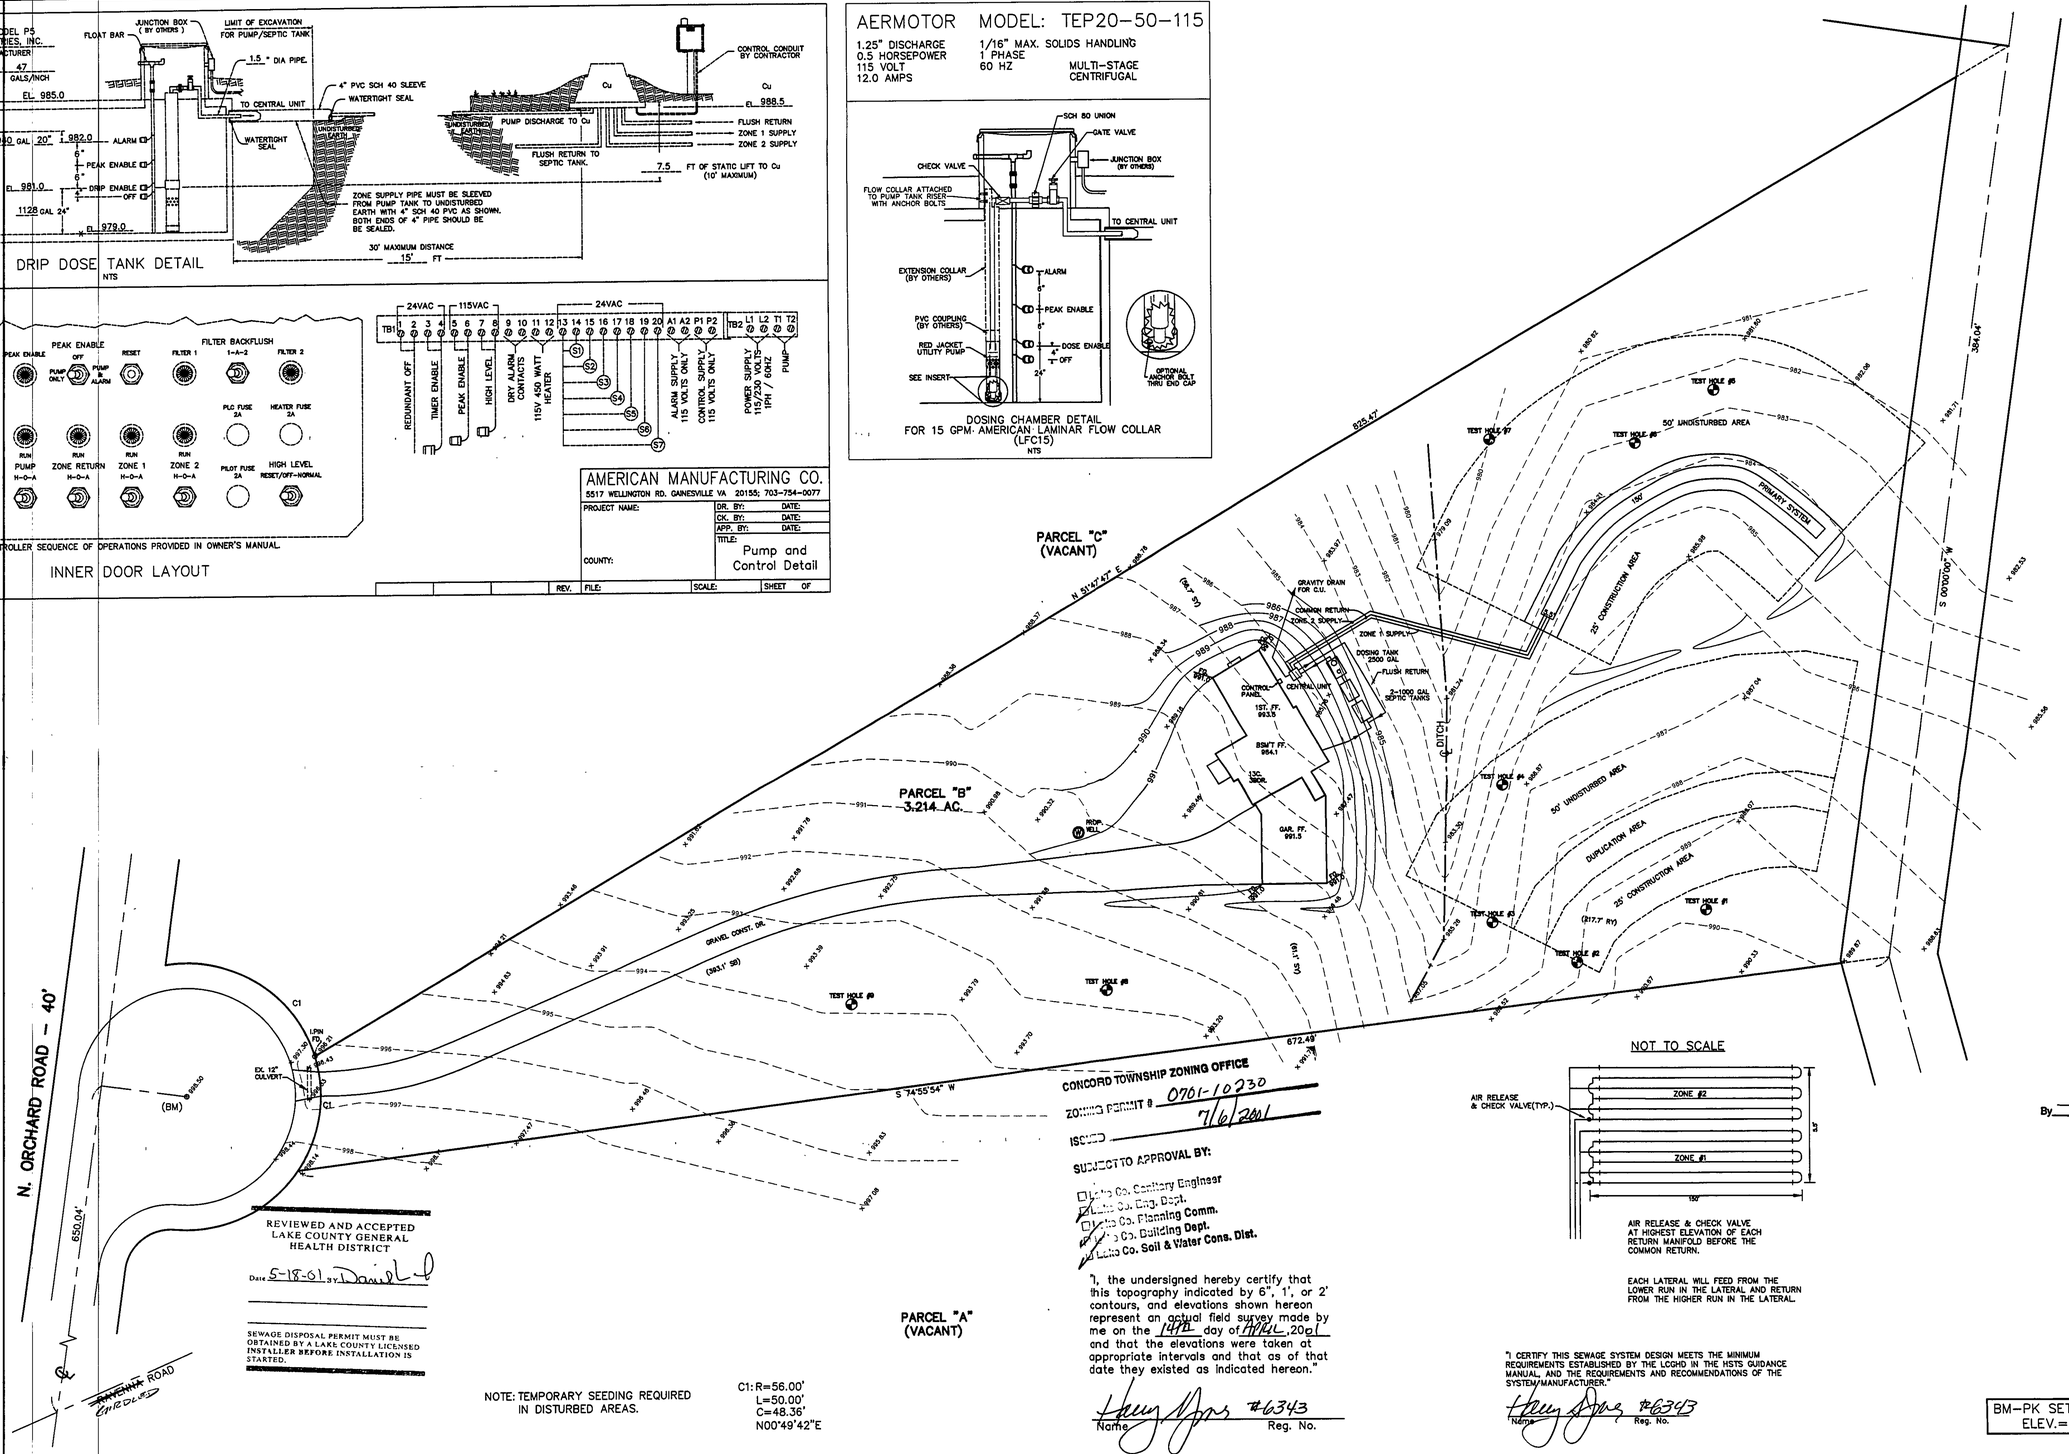

NOT TO SCALE

AIR RELEASE & CHECK VALVE AT HIGHEST ELEVATION OF EACH RETURN MANIFOLD BEFORE THE COMMON RETURN.

EACH LATERAL WILL FEED FROM THE LOWER RUN IN THE LATERAL AND RETURN FROM THE HIGHER RUN IN THE LATERAL.

Grading Plan Approved as shown and/or noted
JAMES R. GILLS, P.E.
Lake County Engineer
By _____ Date 7/10/01

CONCORD TOWNSHIP ZONING OFFICE
ZONING PERMIT # 0701-10230
ISSUED 7/6/2001
SUBJECT TO APPROVAL BY:
☐ Lake Co. Sanitary Engineer
☑ Lake Co. Eng. Dept.
☐ Lake Co. Planning Comm.
☑ Lake Co. Building Dept.
☑ Lake Co. Soil & Water Cons. Dist.

REVIEWED AND ACCEPTED
LAKE COUNTY GENERAL HEALTH DISTRICT
Date 5-18-01 BY Daniel L

SEWAGE DISPOSAL PERMIT MUST BE OBTAINED BY A LAKE COUNTY LICENSED INSTALLER BEFORE INSTALLATION IS STARTED.

NOTE: TEMPORARY SEEDING REQUIRED IN DISTURBED AREAS.

"I, the undersigned hereby certify that this topography indicated by 6", 1', or 2' contours, and elevations shown hereon represent an actual field survey made by me on the 14th day of April, 2001 and that the elevations were taken at appropriate intervals and that as of that date they existed as indicated hereon."

Harry S. Jones #6343
Name Reg. No.

"I CERTIFY THIS SEWAGE SYSTEM DESIGN MEETS THE MINIMUM REQUIREMENTS ESTABLISHED BY THE LCGHD IN THE HSTS GUIDANCE MANUAL, AND THE REQUIREMENTS AND RECOMMENDATIONS OF THE SYSTEM/MANUFACTURER."

Harry S. Jones #6343
Name Reg. No.

BM-PK SET
ELEV.=998.50

STATE OF OHIO PROFESSIONAL SURVEYOR HARRY S. JONES, JR. S-6343 REGISTERED

REV NO.	DESCRIPTION	DATE	BY	CHK'D
1	CHANGED TO DRIP SEPTIC	5/7/01	TR	HJ

BABCOCK, JONES AND ASSOCIATES, INC
CIVIL ENGINEERS – SURVEYORS – LAND PLANNERS
PAINESVILLE OHIO 44077

DATE	4/11/01
DESIGN BY	H.J.
DRAWN BY	T.R.
APPROVED BY	H.J.

SITE PLAN
FOR
CHRIS BEDRICK
CONCORD TOWNSHIP LAKE COUNTY

SCALE	1"=30'
JOB NO.	96-058-B
SHEET	1 OF 2