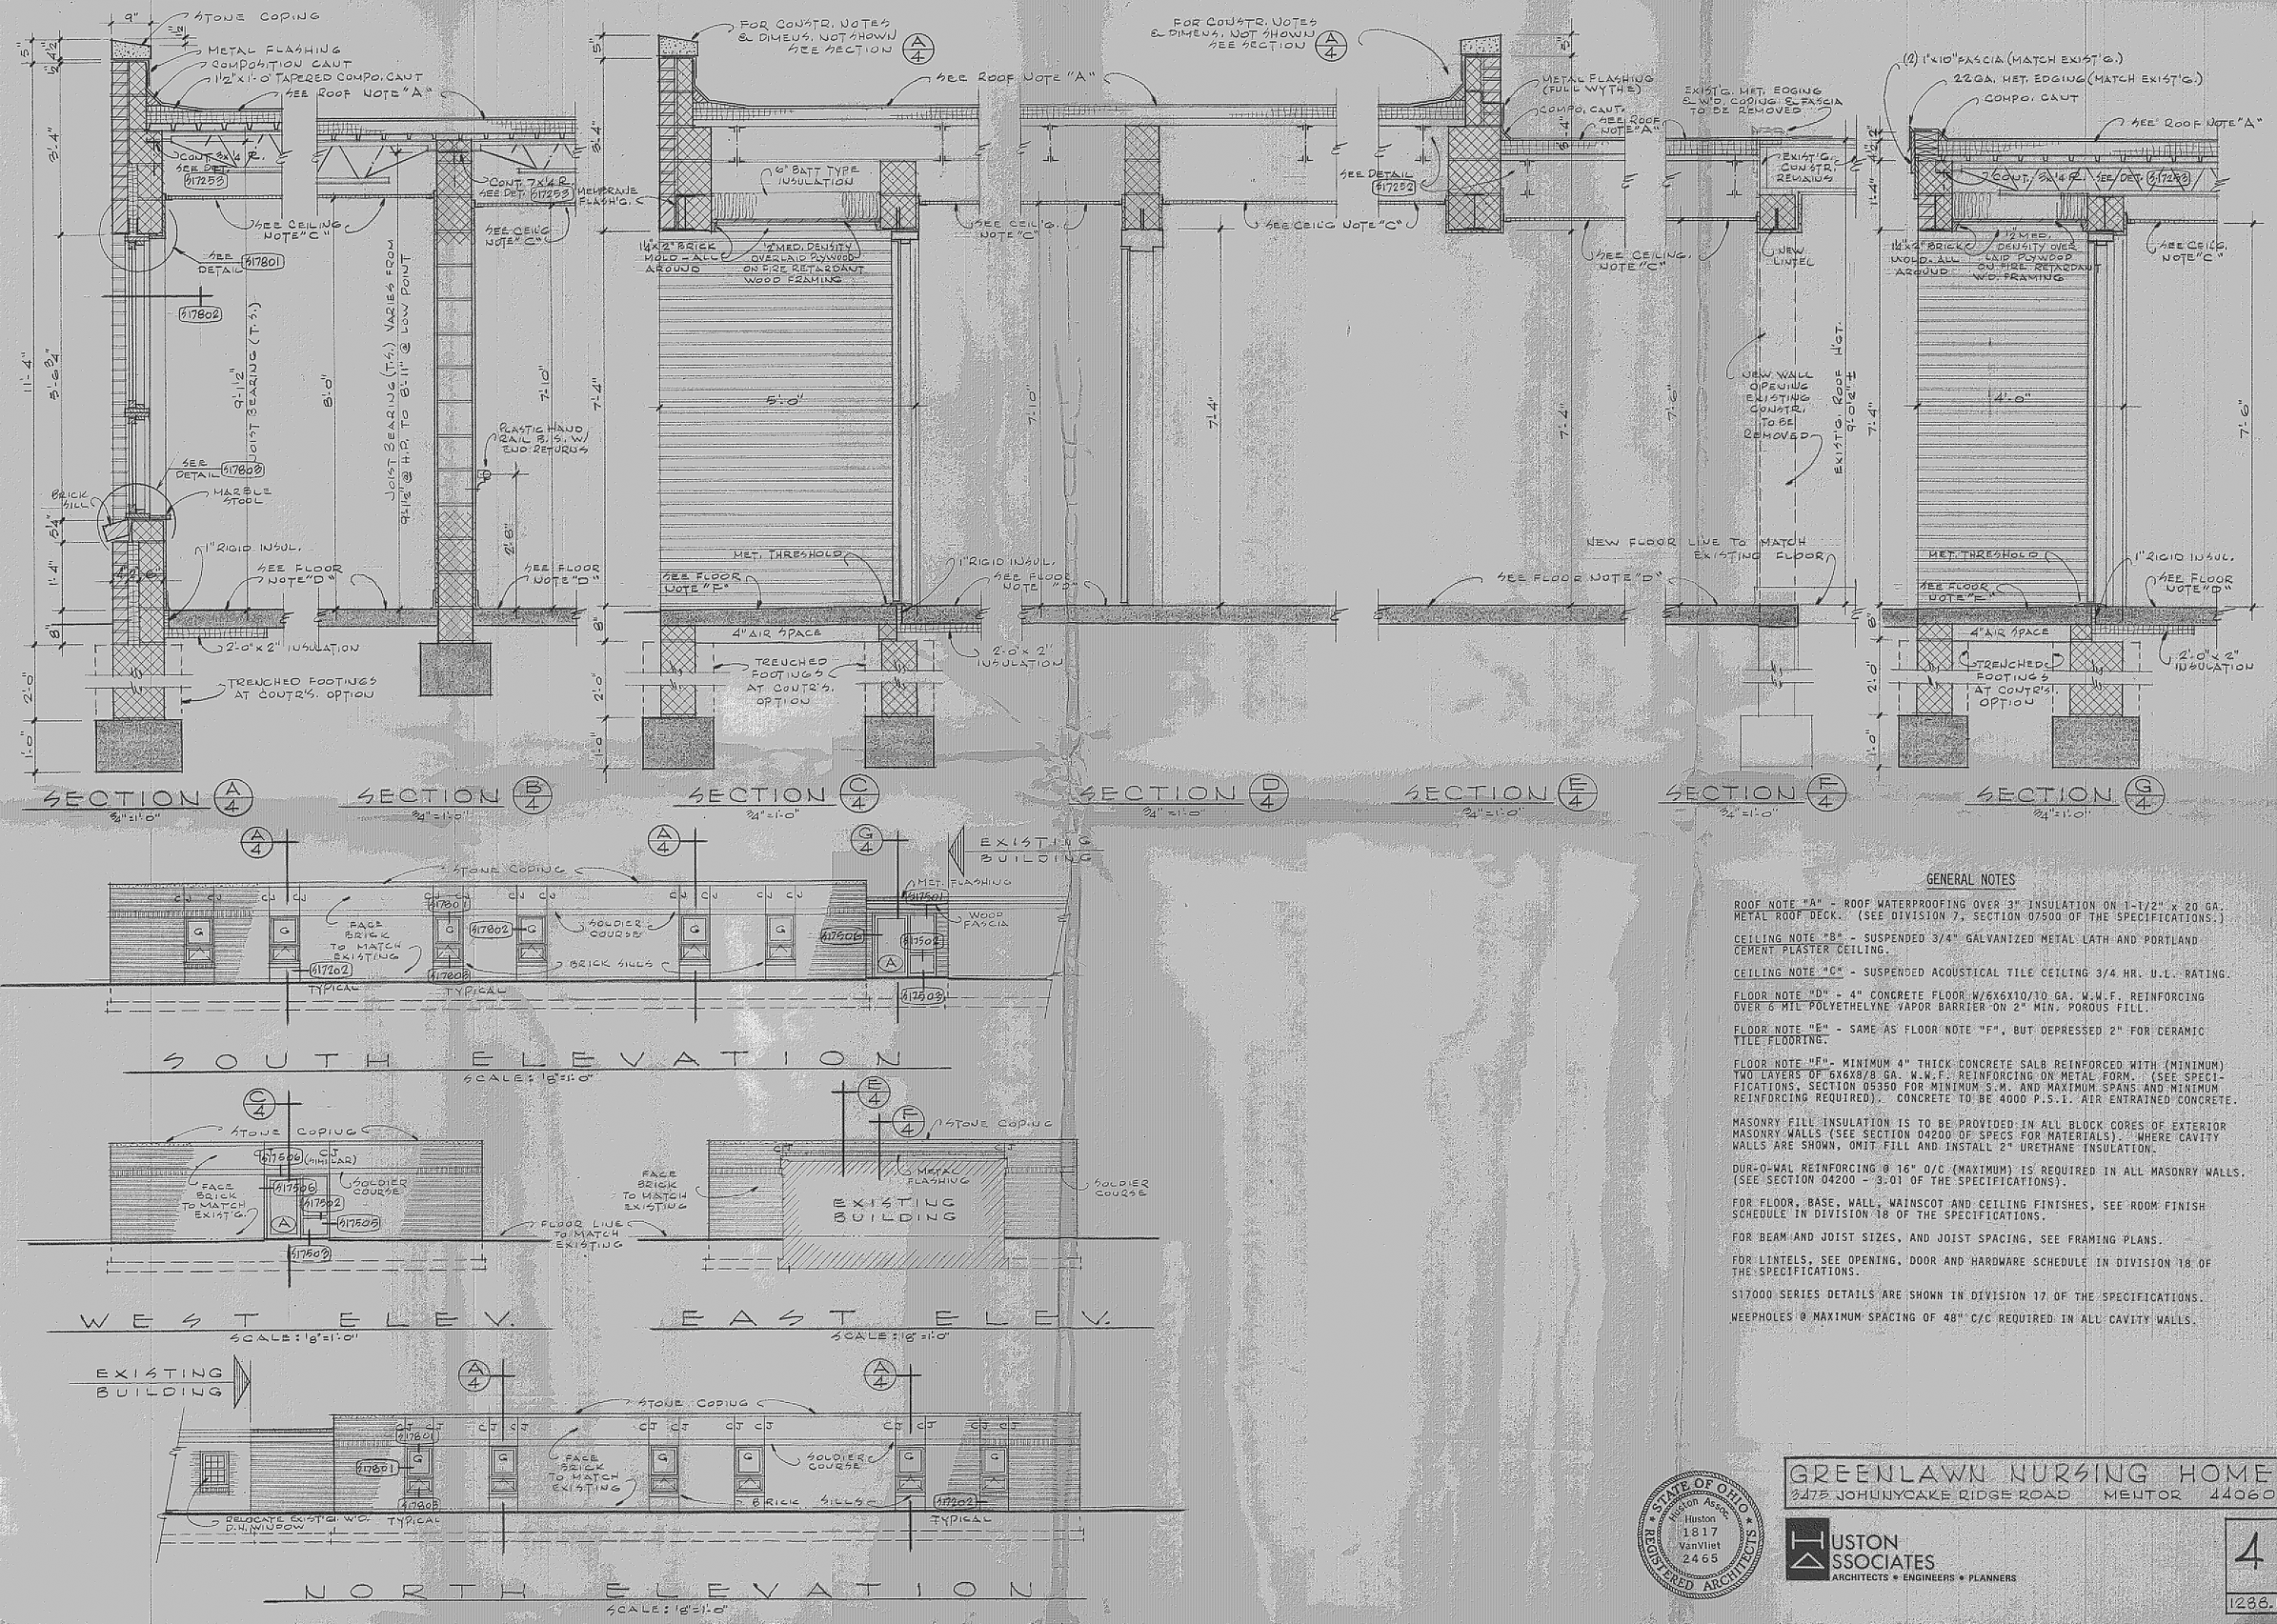

GENERAL NOTES

ROOF NOTE "A" - ROOF WATERPROOFING OVER 3" INSULATION ON 1-1/2" x 20 GA. METAL ROOF DECK. (SEE DIVISION 7, SECTION 07500 OF THE SPECIFICATIONS.)

CEILING NOTE "B" - SUSPENDED 3/4" GALVANIZED METAL LATH AND PORTLAND CEMENT PLASTER CEILING.

CEILING NOTE "C" - SUSPENDED ACOUSTICAL TILE CEILING 3/4 HR. U.L. RATING.

FLOOR NOTE "D" - 4" CONCRETE FLOOR W/6X6X10/10 GA. W.W.F. REINFORCING OVER 6 MIL POLYETHELYNE VAPOR BARRIER ON 2" MIN. POROUS FILL.

FLOOR NOTE "E" - SAME AS FLOOR NOTE "F", BUT DEPRESSED 2" FOR CERAMIC TILE FLOORING.

FLOOR NOTE "F" - MINIMUM 4" THICK CONCRETE SALB REINFORCED WITH (MINIMUM) TWO LAYERS OF 6X6X8/8 GA. W.W.F. REINFORCING ON METAL FORM. (SEE SPECIFICATIONS, SECTION 05350 FOR MINIMUM S.M. AND MAXIMUM SPANS AND MINIMUM REINFORCING REQUIRED). CONCRETE TO BE 4000 P.S.I. AIR ENTRAINED CONCRETE.

MASONRY FILL INSULATION IS TO BE PROVIDED IN ALL BLOCK CORES OF EXTERIOR MASONRY WALLS (SEE SECTION 04200 OF SPECS FOR MATERIALS). WHERE CAVITY WALLS ARE SHOWN, OMIT FILL AND INSTALL 2" URETHANE INSULATION.

DUR-O-WAL REINFORCING @ 16" O/C (MAXIMUM) IS REQUIRED IN ALL MASONRY WALLS. (SEE SECTION 04200 - 3.01 OF THE SPECIFICATIONS).

FOR FLOOR, BASE, WALL, WAINSCOT AND CEILING FINISHES, SEE ROOM FINISH SCHEDULE IN DIVISION 18 OF THE SPECIFICATIONS.

FOR BEAM AND JOIST SIZES, AND JOIST SPACING, SEE FRAMING PLANS.

FOR LINTELS, SEE OPENING, DOOR AND HARDWARE SCHEDULE IN DIVISION 18 OF THE SPECIFICATIONS.

S17000 SERIES DETAILS ARE SHOWN IN DIVISION 17 OF THE SPECIFICATIONS.

WEEPHOLES @ MAXIMUM SPACING OF 48" C/C REQUIRED IN ALL CAVITY WALLS.

STATE OF OHIO
Huston Assoc.
Huston 1817
VanVliet 2465
REGISTERED ARCHITECTS

GREENLAWN NURSING HOME
8475 JOHNNYCAKE RIDGE ROAD MENTOR 44060

HUSTON ASSOCIATES
ARCHITECTS • ENGINEERS • PLANNERS

4
1288.1