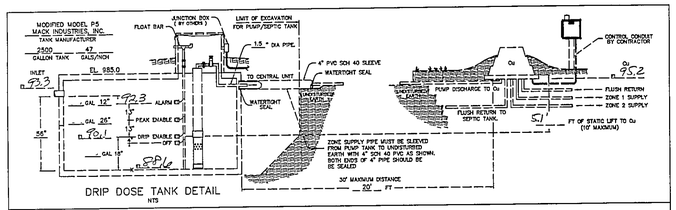
MODIFIED MODEL P5
MACK INDUSTRIES, INC.
TANK MANUFACTURER
2500 GALLON TANK
47 GALS/INCH
JUNCTION BOX (BY OTHERS)
FLOAT BAR
LIMIT OF EXCAVATION FOR PUMP/SEPTIC TANK
1.5" DIA PIPE
TO CENTRAL UNIT
4" PVC SCH 40 SLEEVE
WATERTIGHT SEAL
CONTROL CONDUIT BY CONTRACTOR
FLUSH RETURN
ZONE 1 SUPPLY
ZONE 2 SUPPLY
FT OF STATIC LIFT TO CU (10' MAXIMUM)
PUMP DISCHARGE TO CU
FLUSH RETURN TO SEPTIC TANK
ZONE SUPPLY PIPE MUST BE SLEEVED FROM PUMP TANK TO UNDERGROUND BARRIER WITH 4" SCH 40 PVC AS SHOWN. BOTH ENDS OF 4" PIPE SHOULD BE RE SEALED
30' MAXIMUM DISTANCE
ALARM
PEAK ENABLE
DRIP ENABLE
FL 685.0
FL 679.1
FL 676.6
FL 675.2
FL 675.2
FL 675.2