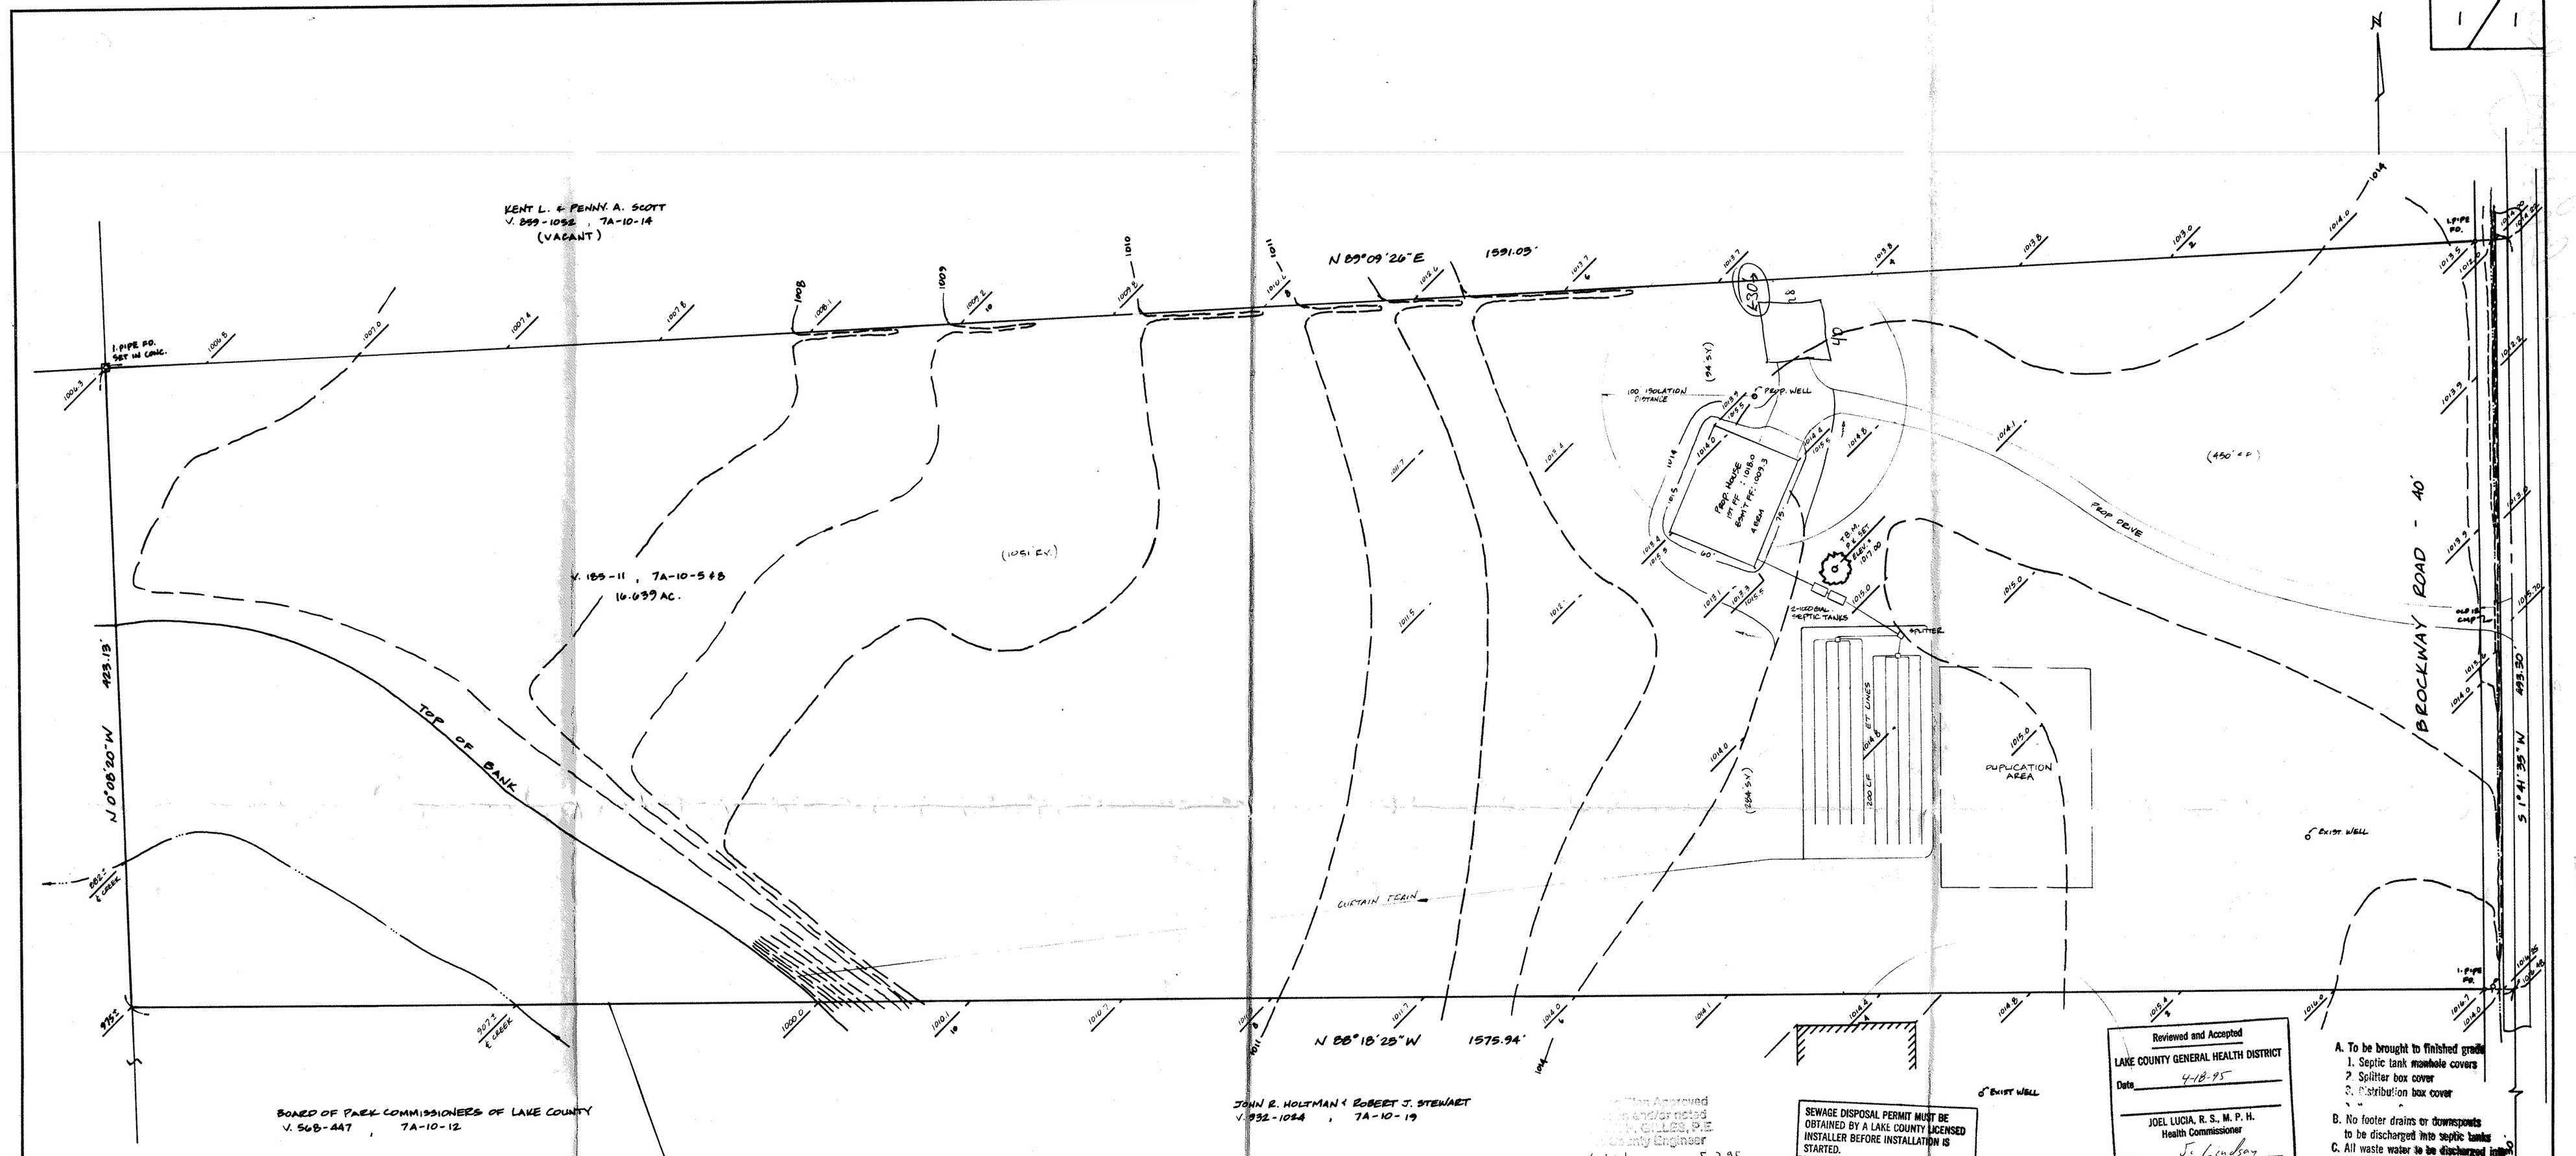

Reviewed and Accepted
LAKE COUNTY GENERAL HEALTH DISTRICT
Date 4-18-95
JOEL LUCIA, R. S., M. P. H.
Health Commissioner
BY J. Lindsay

SEWAGE DISPOSAL PERMIT MUST BE OBTAINED BY A LAKE COUNTY LICENSED INSTALLER BEFORE INSTALLATION IS STARTED.

Plan Approved
John and/or notated
Frank Gilles, P.E.
County Engineer
GJH Date 5 3 95

A. To be brought to finished grade
1. Septic tank manhole covers
2. Splitter box cover
3. Distribution box cover
B. No footer drains or downspouts to be discharged into septic tanks
C. All waste water to be discharged into septic tanks

LOW YIELD WATER FIXTURES REQUIRED ON ALL:
__ Shower Head
__ Toilet

LEROY CENTER RD.

LEROY TOWNSHIP Zoning Approved #2225 Zoning Inspector

STATE OF OHIO
HARRY S. JONES, JR.
S-6343
REGISTERED SURVEYOR

"I, the undersigned hereby certify that the topography indicated by 6", 1' or 2' contours, and elevations shown hereon represent an actual field survey made by me on the 23rd day of FEB, 1995 and that the elevations were taken at appropriate intervals and that as of that date they existed as indicated hereon."

Name Reg. No. 6343

EVAPORATION - TRANSPIRATION TRENCH CROSS SECTION

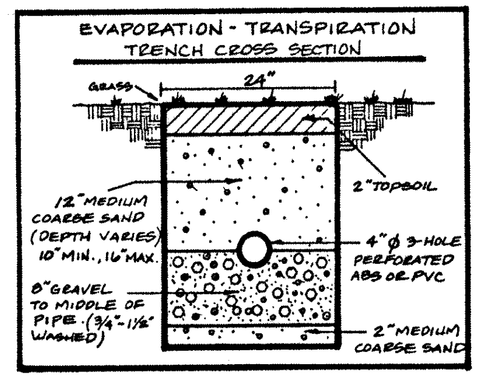

CURTAIN DRAIN CROSS SECTION

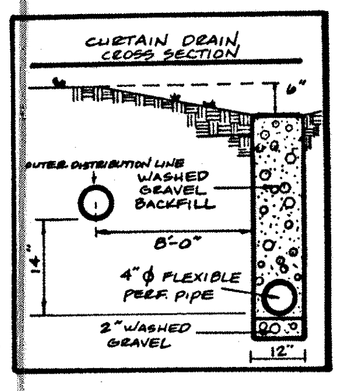

HYDRAULIC PROFILE
HORZ. 1" = 30' VERT. 1" = 5'

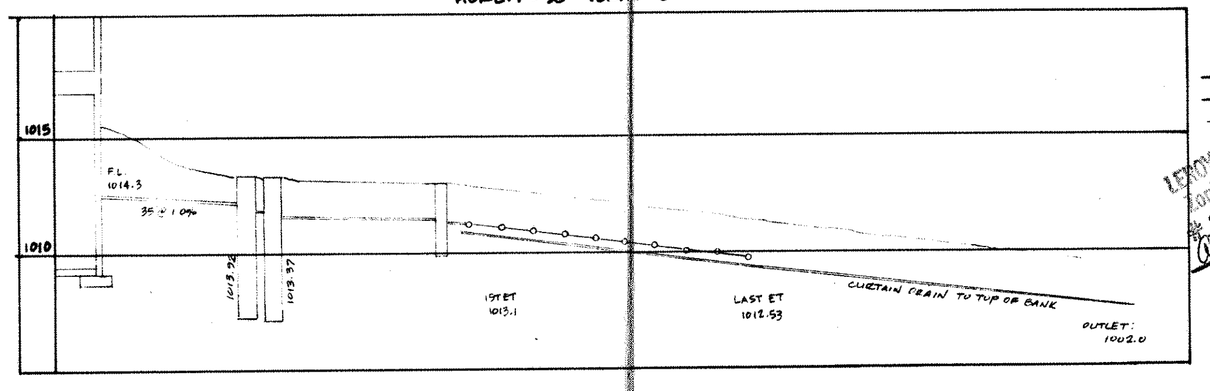

REV NO.	DESCRIPTION	DATE	BY	CHKD
1	RELOCATE SEPTIC PER L.C. HEALTH DEPT.	4/7/95		

SITE PLAN
FOR
LARRY ORIENT

BABCOCK, JONES AND ASSOCIATES, INC
CIVIL ENGINEERS - SURVEYORS - LAND PLANNERS
PAINESVILLE OHIO 44077

DATE FEBRUARY 1995
DESIGN BY HT
DRAWN BY
APPROVED BY HT

V. 183-11 , P.P.# 7A-10-5 & 8
LEROY TOWNSHIP LAKE COUNTY OHIO

SCALE 1" = 30'
JOB NO. 95-020
SHEET 1 OF 1

874139