SHEET 1 OF 1

Reviewed and Accepted
LAKE COUNTY GENERAL HEALTH DISTRICT
Date 12-22-93
JOEL LUCIA, R. S., M. P. H.
Health Commissioner
BY J. Lindsey

LOW YIELD WATER FIXTURES REQUIRED ON ALL:
__ Shower Head
__ Toilet
__

A. To be brought to finished grade
1. Septic tank manhole covers
2. Splitter box cover
3. Distribution box cover
B. No footer drains or downspouts to be discharged into septic tanks
C. All waste water to be discharged into septic tanks

SEWAGE DISPOSAL PERMIT MUST BE OBTAINED BY A LAKE COUNTY LICENSED INSTALLER BEFORE INSTALLATION IS STARTED.

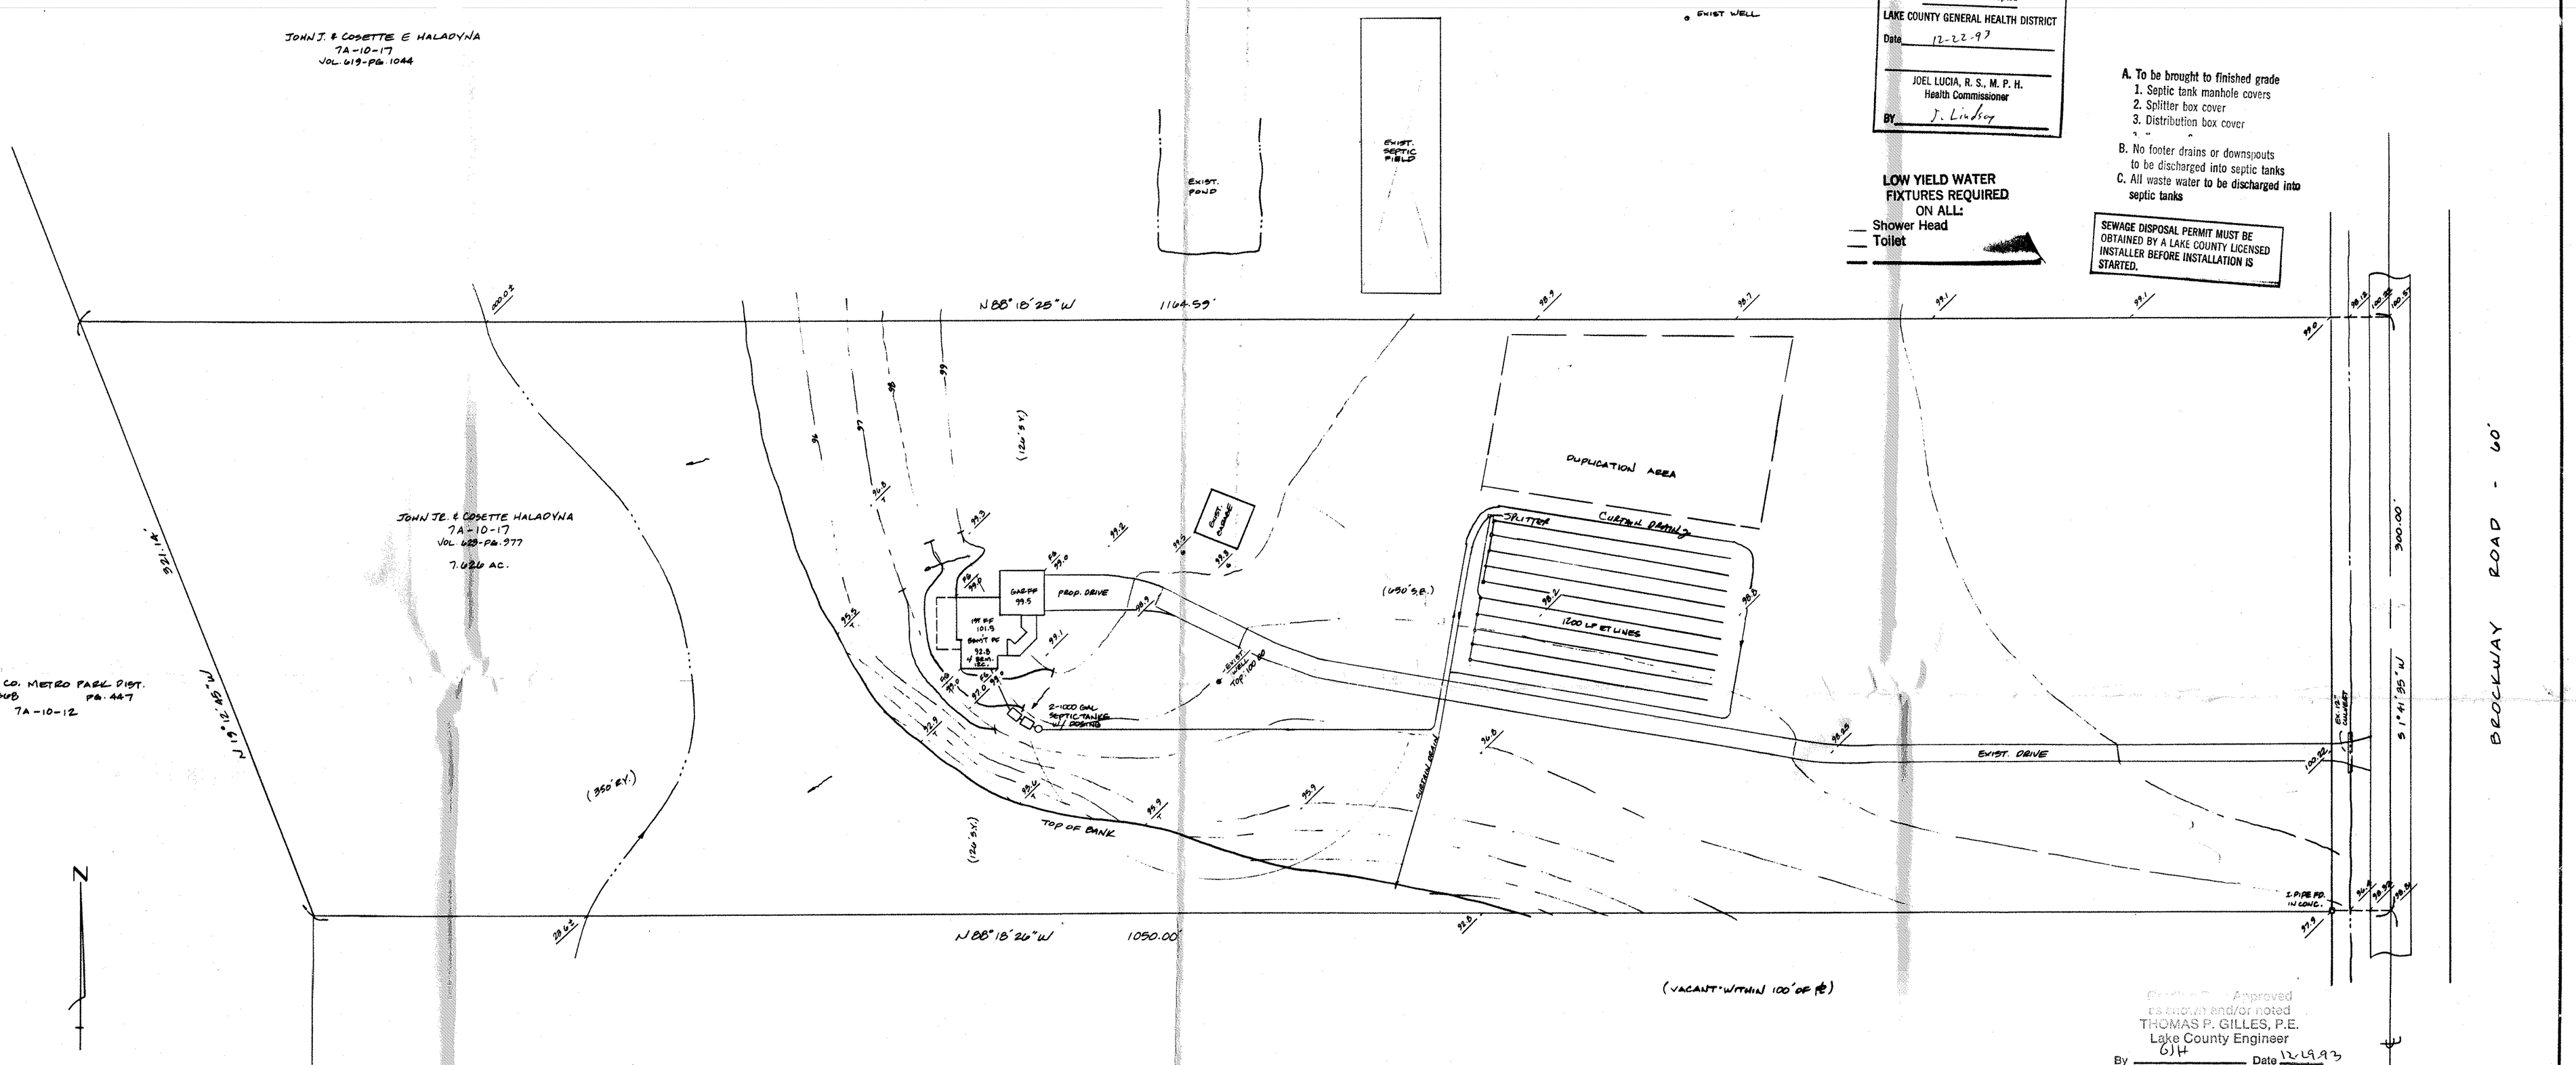

Approved
as shown and/or noted
THOMAS P. GILLES, P.E.
Lake County Engineer
By GH Date 12.29.93

"I, the undersigned hereby certify that this topography indicated by 6", 1' or 2' contours, and elevations shown hereon represent an actual field survey made by me on the 15th day of Aug. 1973 and that the elevations were taken at appropriate intervals and that as of that date they existed as indicated hereon."
Name Reg. No. #6343



END. DIMENSIONS

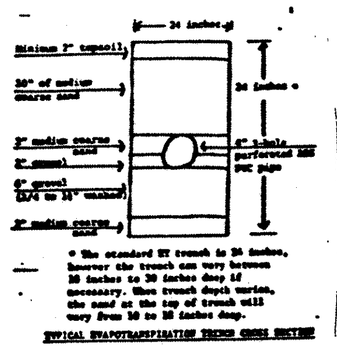

* The standard 24" trench is 24 inches, however the trench can vary between 20 inches to 30 inches deep if necessary. Thus trench depth varies, the sand at the top of trench will vary from 18 to 28 inches deep.

TYPICAL EVAPOTRANSPIRATION TRENCH CROSS SECTION

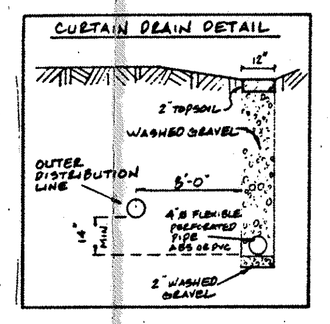

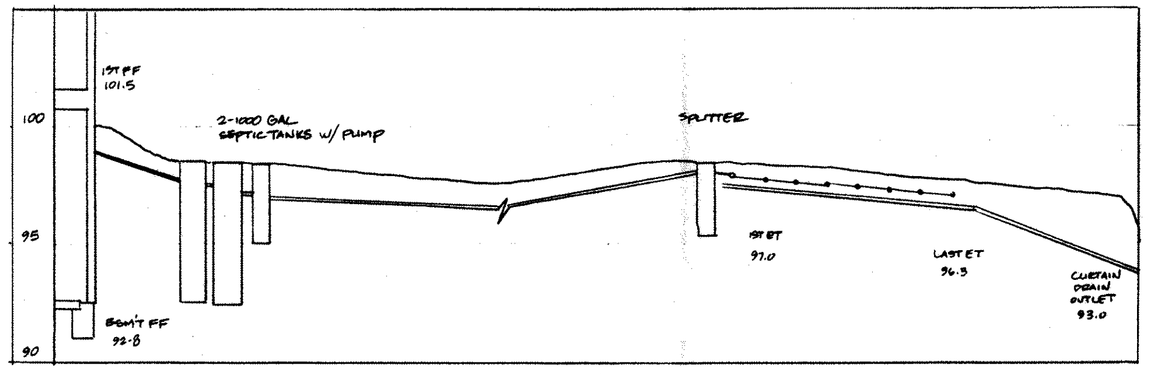

HYDRAULIC PROFILE
HORZ. 1"=30', VERT. 1"=5'

℄ LEROY CENTER RD. - 60'
LEROY TOWNSHIP

STATE OF OHIO
HARRY S. JONES, JR.
S-6343
REGISTERED SURVEYOR

REV NO.	DESCRIPTION	DATE	BY	CH'K'D

SITE PLAN
FOR
JOHN HALADYNA

BABCOCK, JONES AND ASSOCIATES, INC
CIVIL ENGINEERS - SURVEYORS - LAND PLANNERS
PAINESVILLE OHIO 44077

DATE NOVEMBER 17, 1993
DESIGN BY HT
DRAWN BY
APPROVED BY HT

PERM. PARCEL # 7A-10-17 , VOL. 629-PG. 977
LEROY TOWNSHIP - LAKE COUNTY - OHIO

SCALE 1"=40'
JOB NO. 87-129
SHEET 1 OF 1