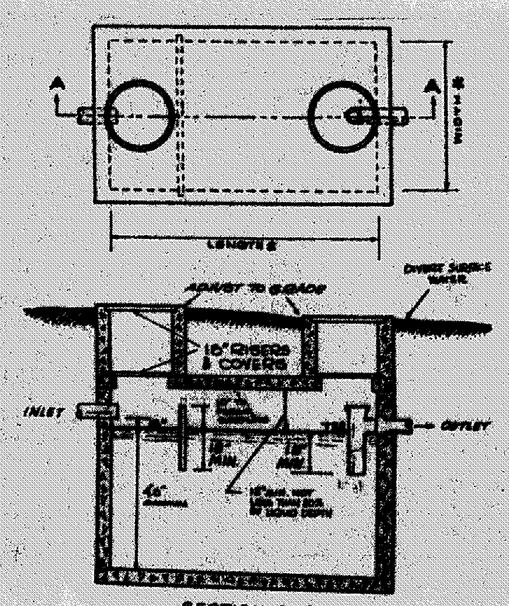

* Dimensions - The following general criteria should be followed.

(1) Ratio of length to width to depth, 2:1:1. If dual compartment tanks are used, this may be increased to 4:1:1, overall.

(2) Maximum width, 10 ft.

(3) Minimum liquid depth, 4 ft.

(4) Maximum liquid depth, 10 ft.

(5) Minimum free board, 1/4 of liquid depth.

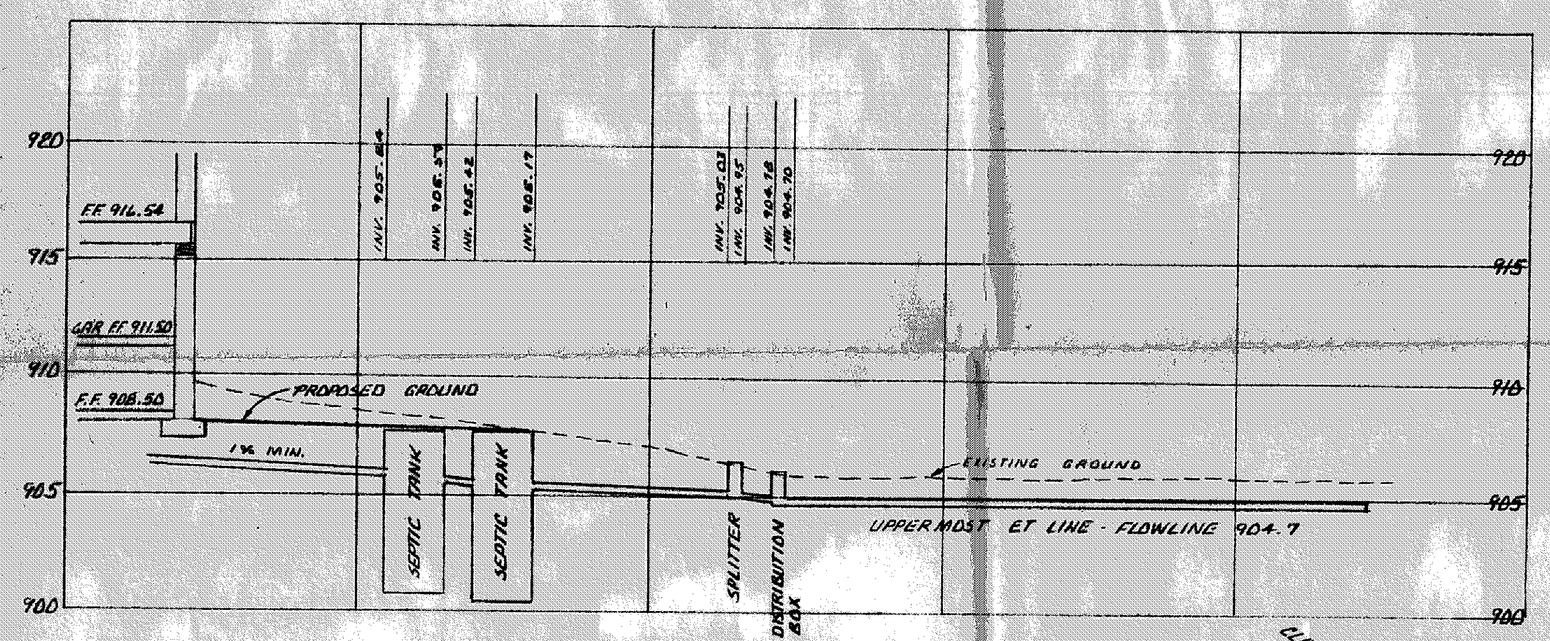

HYDRAULIC PROFILE

SCALES: HORIZ. 1" = 20'
VERT. 1" = 5'

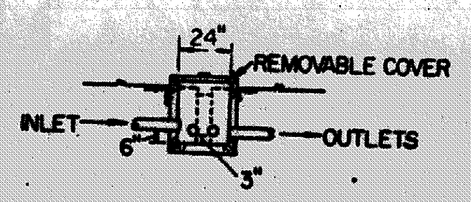

DISTRIBUTION BOX SECTION

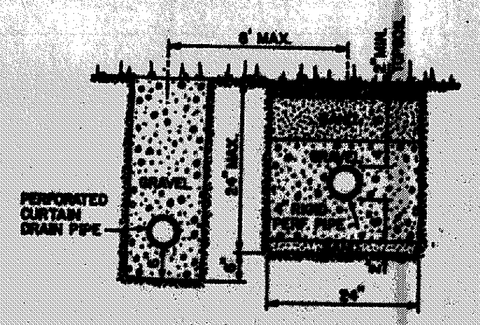

TRENCH DETAIL

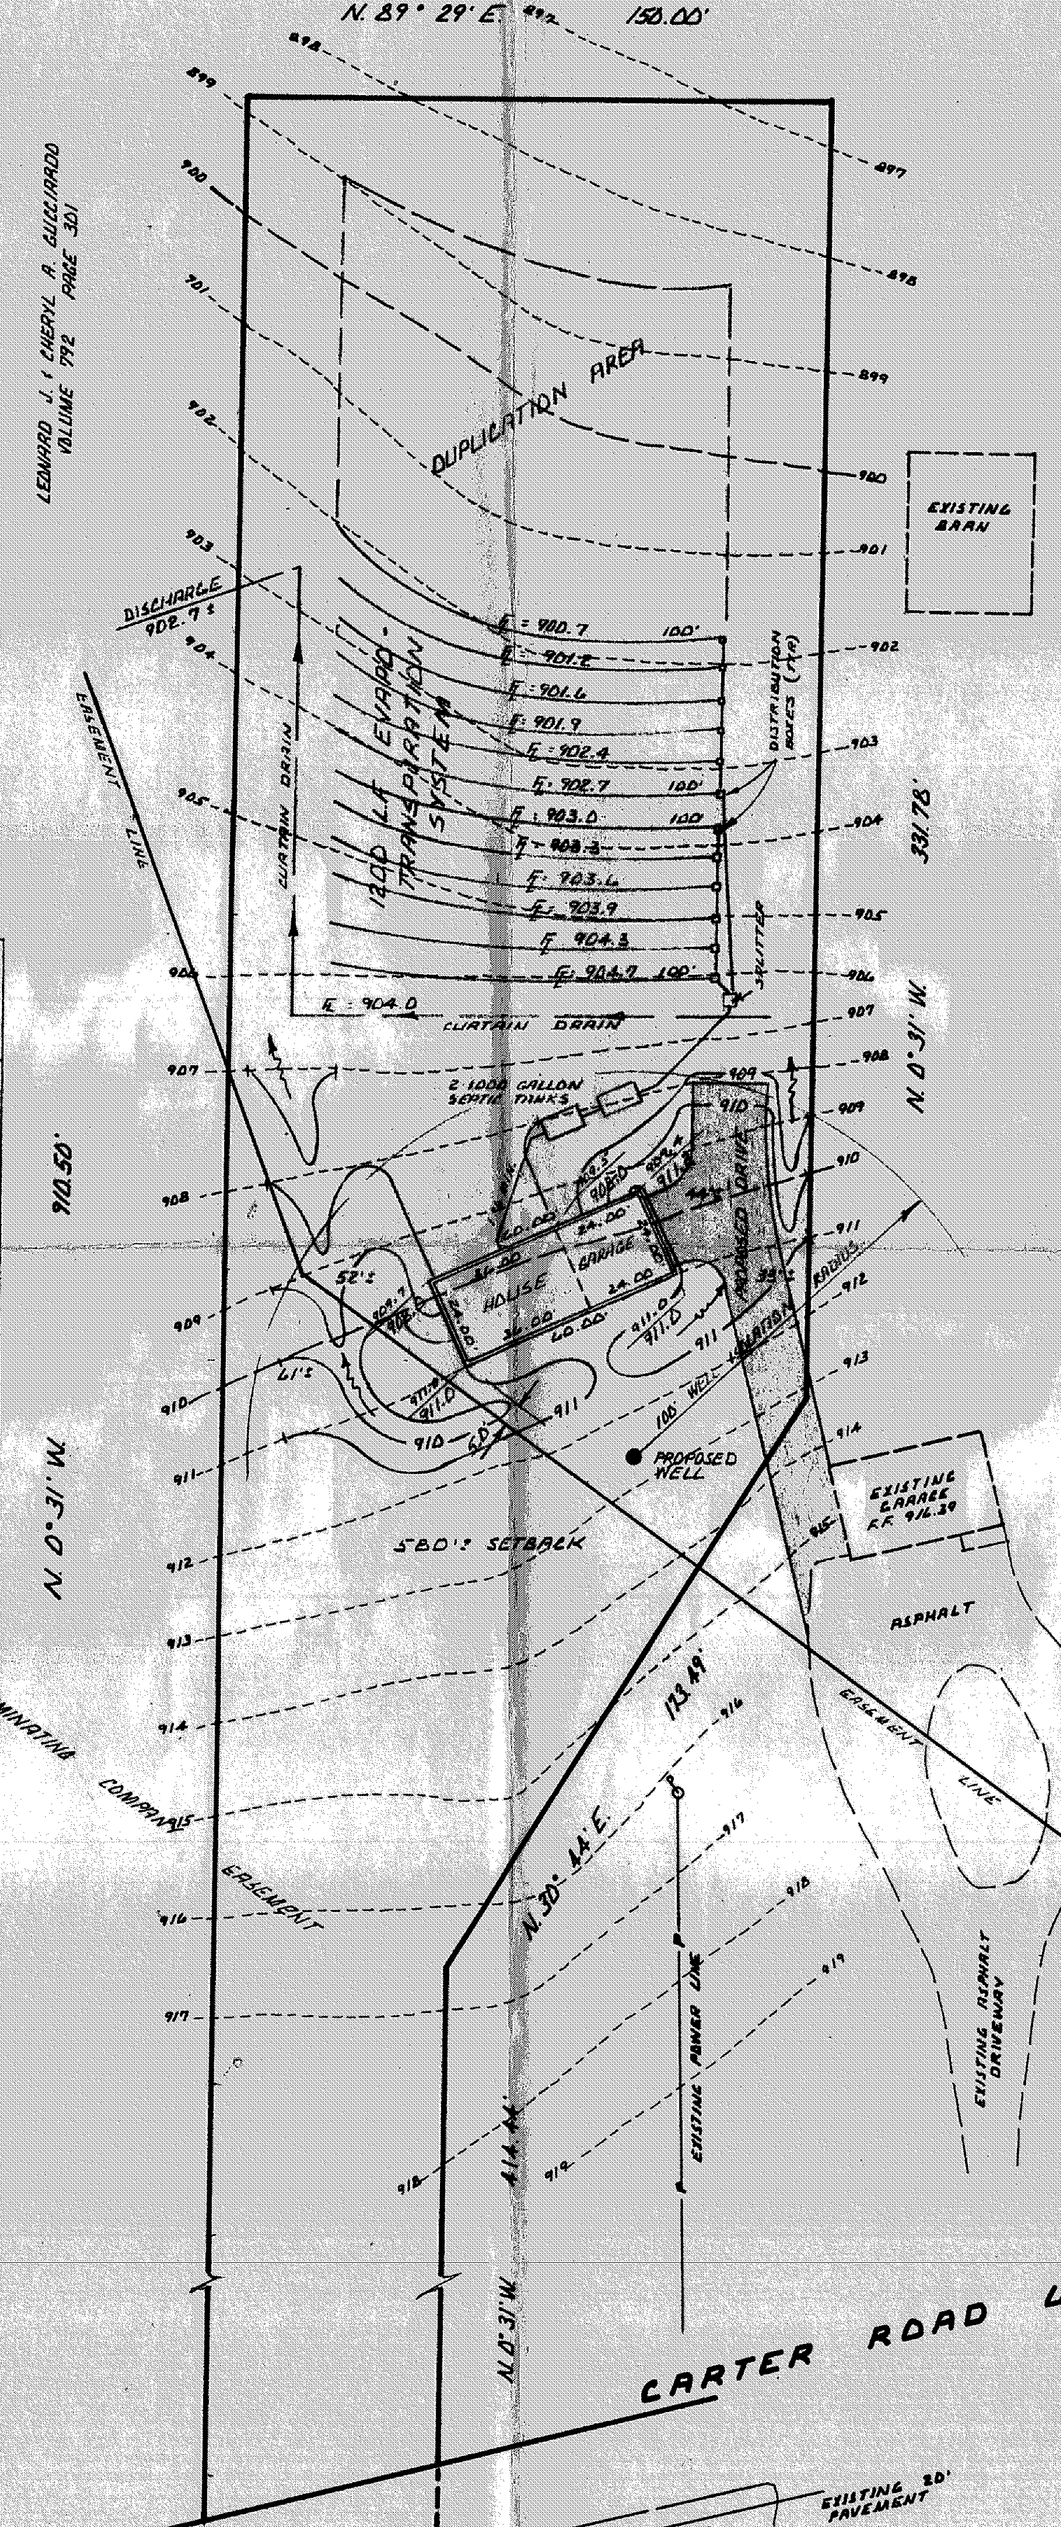

DORIS A. CUTLIP
VOL. 400 PG. 127

Grading Plan Approved
as shown and/or noted
THOMAS P. GILLES, P.E.
Lake County Engineer
By _____ Date 10/6/88

PROPOSED HOUSE FLOOR GRADES

BASEMENT FIN. FLR.: 908.50
GARAGE FIN. FLR.: 911.50
FOYER FIN. FLR.: 912.52
UPPER FIN. FLR.: 916.54

LEONARD J. & CHERYL A. GUCCIARDO
VOLUME 792 PAGE 301

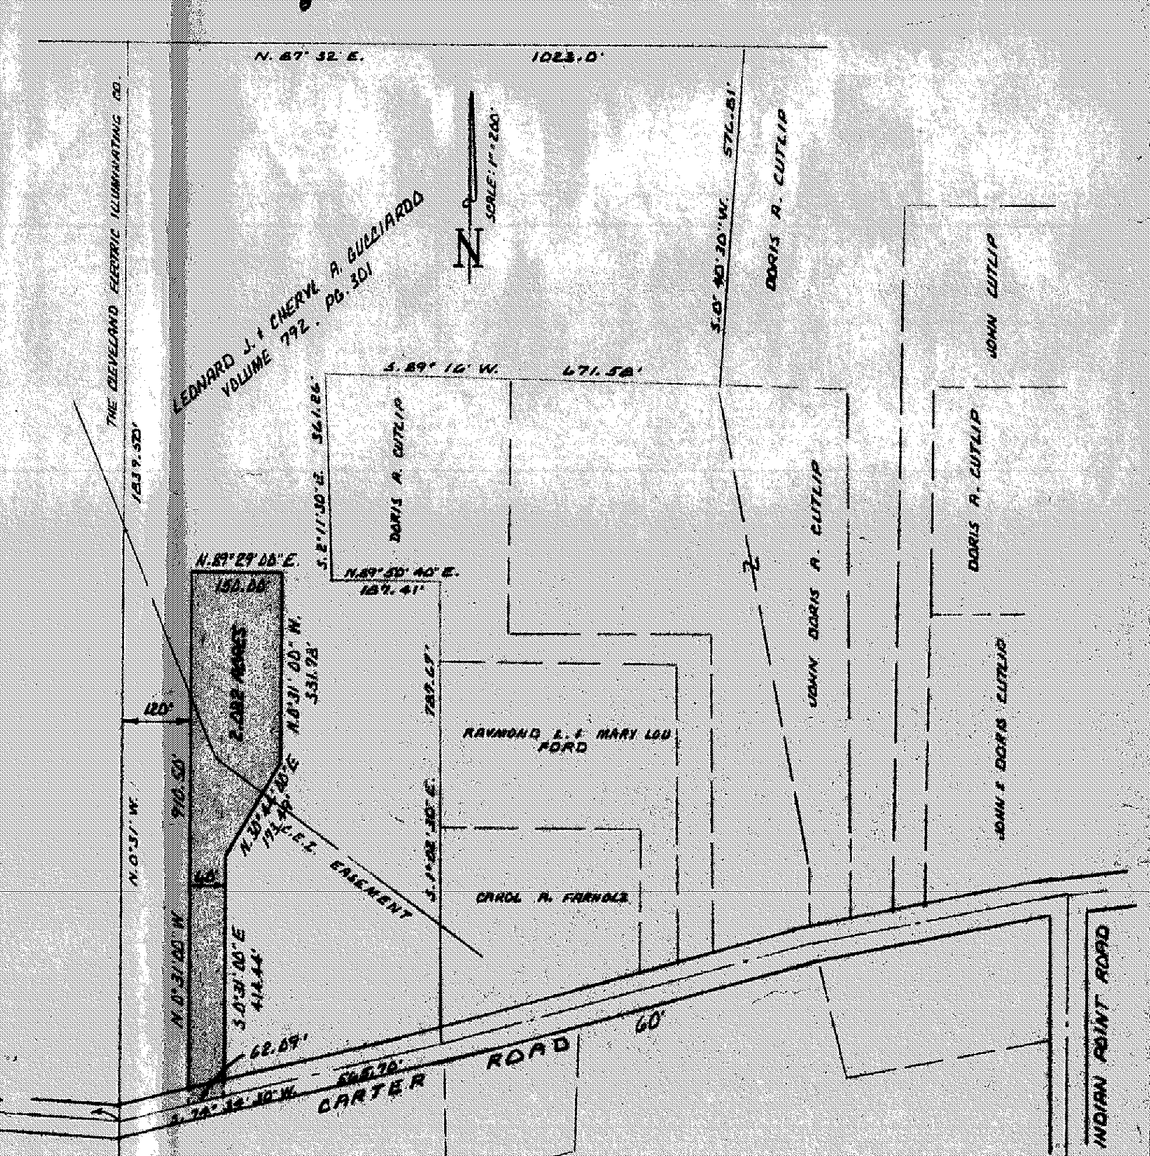

Sub: LEONARD GUCCIARDO
13045 CARTER ROAD LEROY
LOT LEROY TOWNSHIP

LAKE DESIGN consultants

SURVEYOR CERTIFICATION

THIS PLAT THE COMPLETED BY ME, AND IS CORRECT TO THE BEST OF MY KNOWLEDGE AND BELIEF.

6253

CERTIFICATE LIST

STATE OF OHIO
ROY M. KERR
5753
REGISTERED
PROFESSIONAL SURVEYOR

"AS BUILT" CERTIFICATION

I HEREBY CERTIFY THAT THE COMPLETED INFORMATION IS CONTAINED AS CONTAINED ON THIS PLAN, IS _____ AND IS CORRECT TO THE BEST OF MY KNOWLEDGE AND BELIEF.

LICENSED

DRAWN BY RK	SCALE 1" = 20'
CHECK BY	DATE 10-6-88

DIMENSIONS

TOP OF MONUMENT BOX AT CENTERLINE INTERSECTION OF VROMAN ROAD & CARTER ROAD. ELEVATION: 896.00.