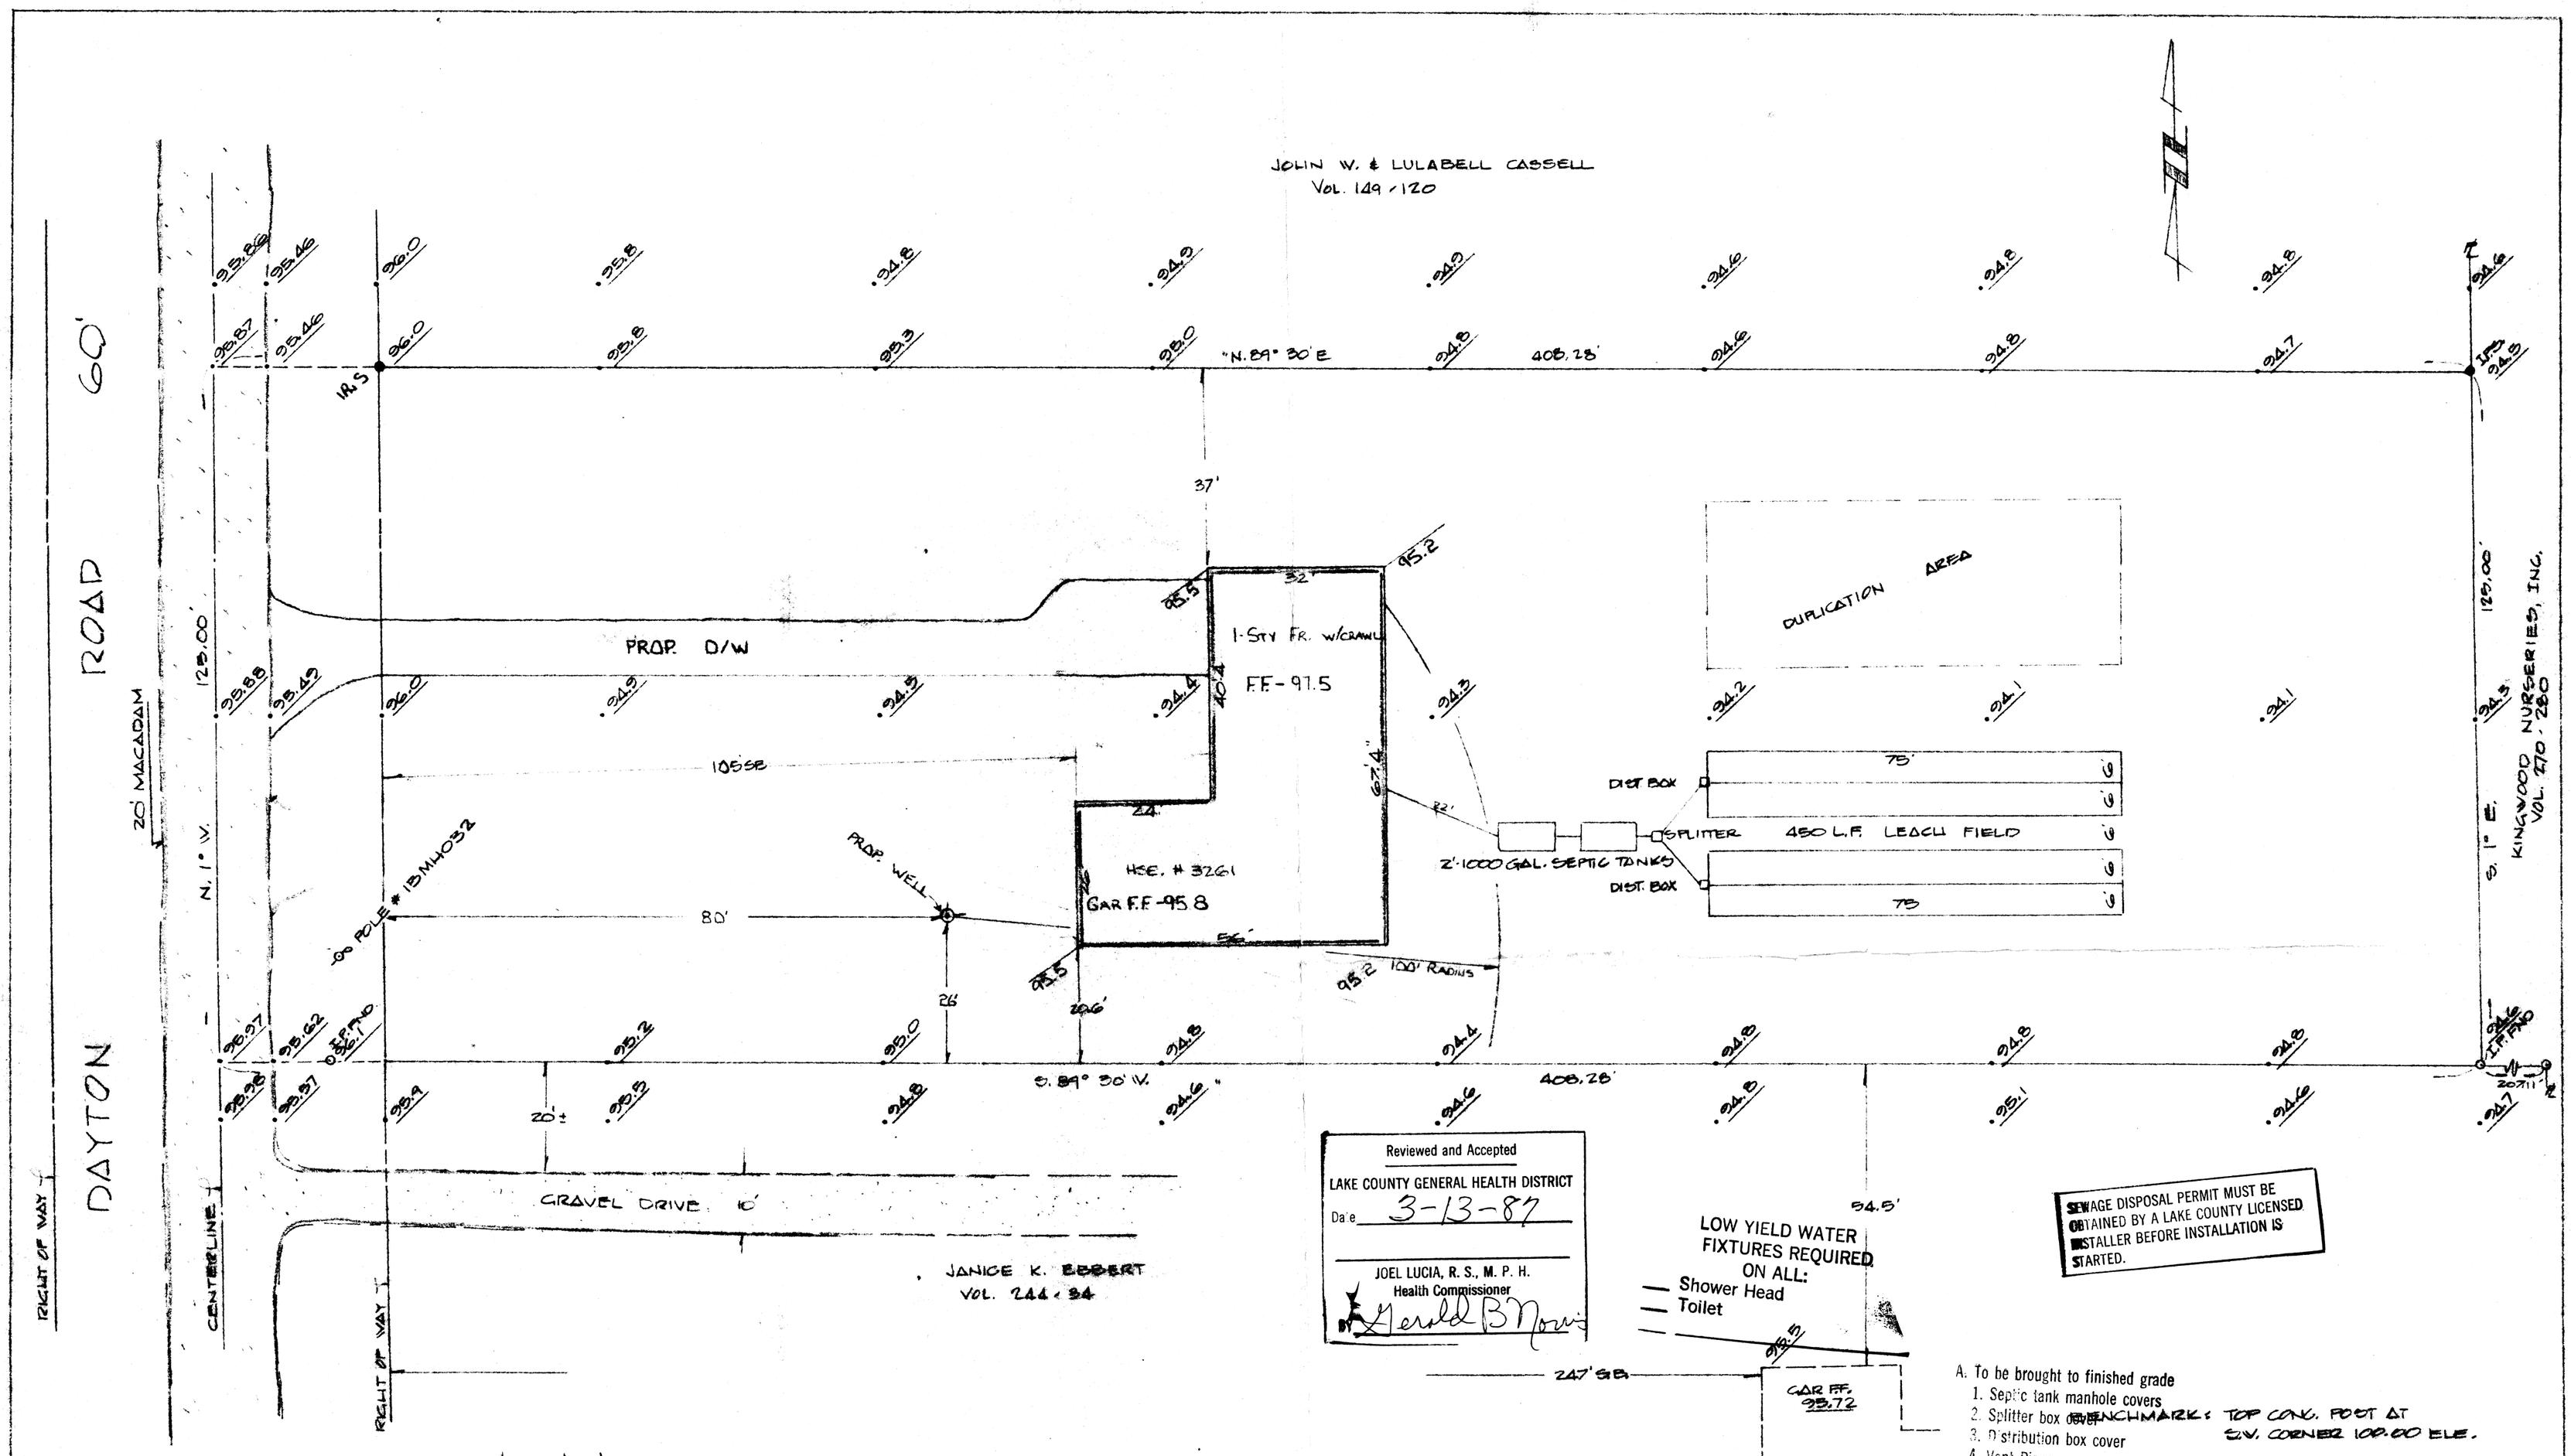

Reviewed and Accepted
LAKE COUNTY GENERAL HEALTH DISTRICT
Date 3-13-87
JOEL LUCIA, R. S., M. P. H.
Health Commissioner
BY Gerald B Norris

LOW YIELD WATER FIXTURES REQUIRED ON ALL:
— Shower Head
— Toilet

SEWAGE DISPOSAL PERMIT MUST BE OBTAINED BY A LAKE COUNTY LICENSED INSTALLER BEFORE INSTALLATION IS STARTED.

A. To be brought to finished grade
1. Septic tank manhole covers
2. Splitter box cover
3. Distribution box cover
4. Vent Pipes
B. No footer drains or downspouts to be discharged into septic tanks
C. All waste water to be discharged into septic tanks

BENCHMARK: TOP CONC. POST AT S.W. CORNER 100.00 ELE.

EXISTING PROPOSED Grading Plan Approved as shown and/or noted
THOMAS P. GILLES, P.E.
County Engineer
Date 3-19-87

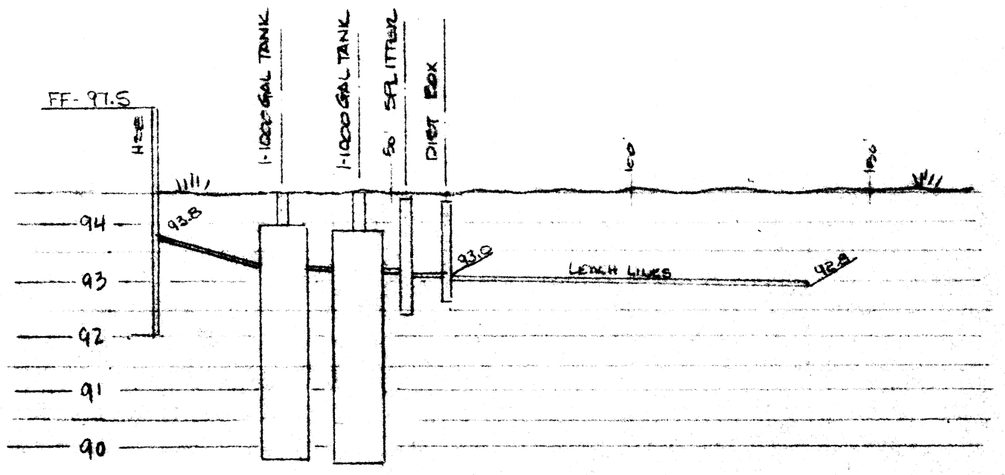

SYSTEM PROFILE
SCALE AS NOTED

APPROVED
MADISON TWP. ZONING
Permit: 12013
Zoning Inspector: K. Gaunt

STATE OF OHIO
THOMAS MARC COFFMAN
6857
REGISTERED
SURVEYOR

THIS PLAT WAS PREPARED BY ME, AND IS CORRECT TO THE BEST OF MY KNOWLEDGE AND BELIEF.
Thomas M. Coffman P.S.
THOMAS M. COFFMAN NO. 6857

SITE PLAN FOR ROLAND & FANNIE CHAPMAN

SCALE 1" = 20' | MARCH 1987

BEING PART OF TRACT 2, LOT 8 IN MADISON TWP., LAKE COUNTY, STATE OF OHIO.