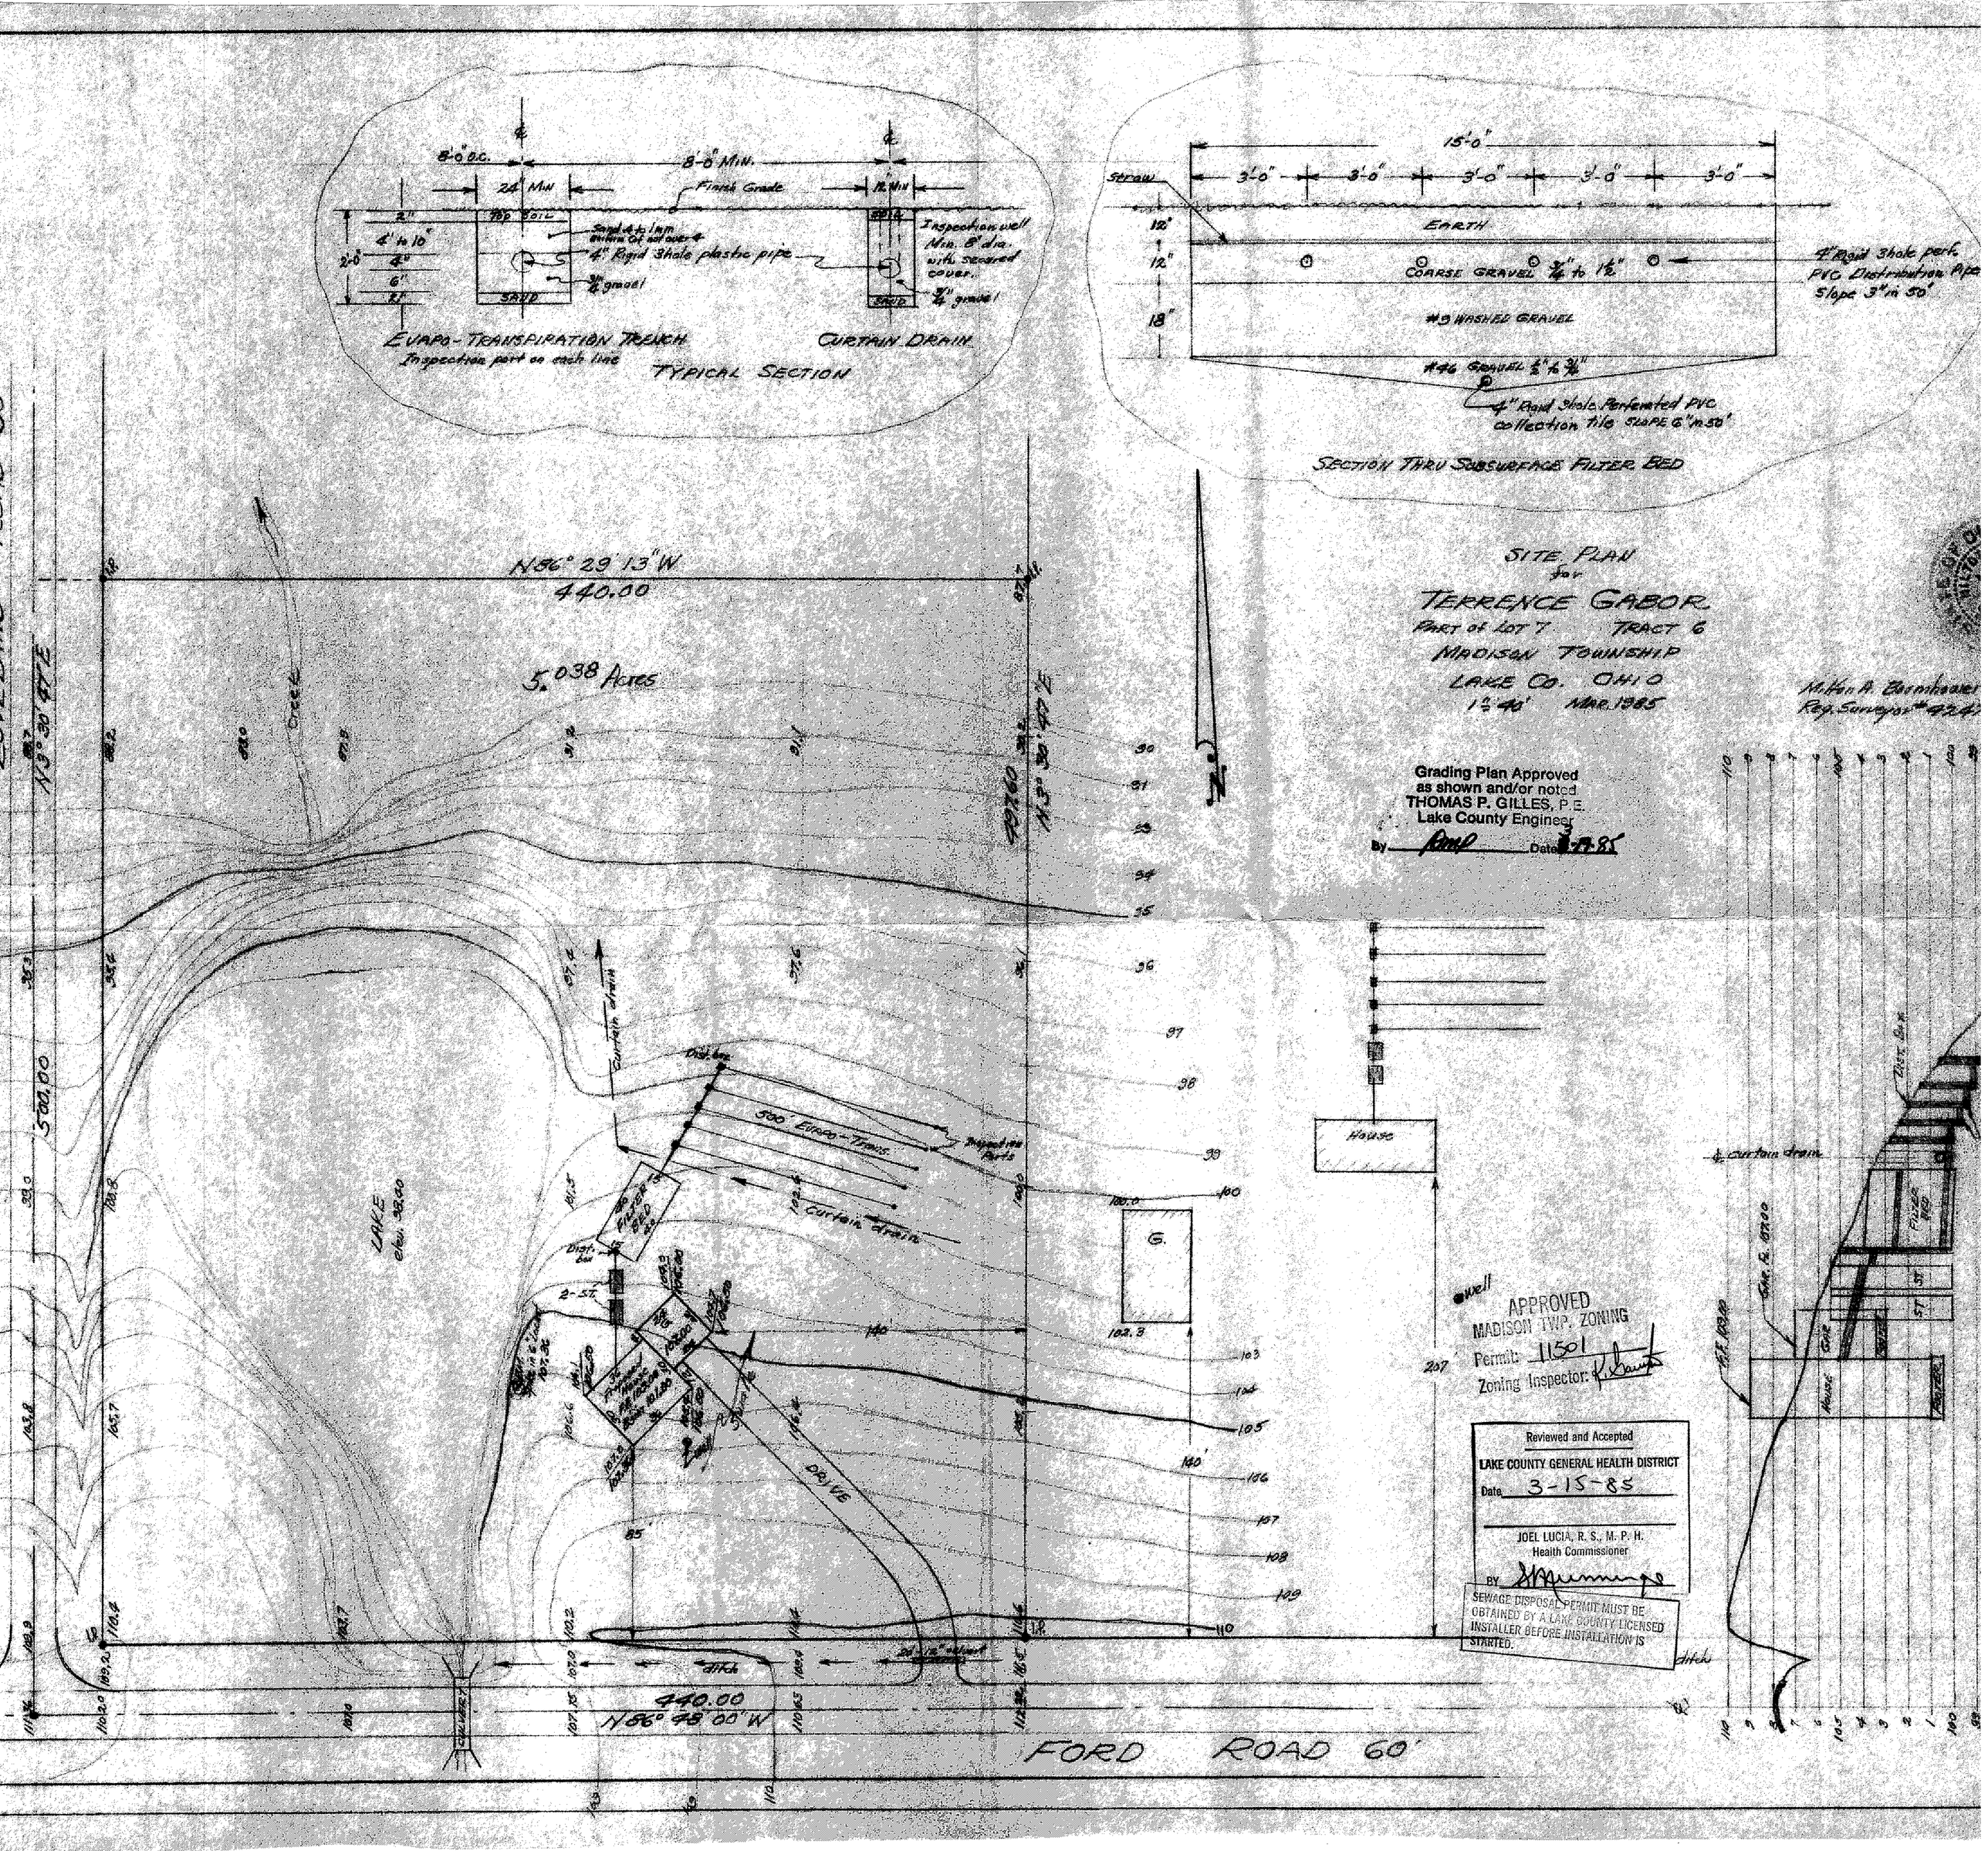

8'-0" O.C.
8'-0" MIN.
24" MIN
Finish Grade
12" MIN
Top Soil
Sand 4 to 1 mm
4" Rigid Shale plastic pipe
3/4" gravel
Inspection well Min. 8" dia. with secured cover.
SAND
EVAPO-TRANSPIRATION TRENCH
Inspection port on each line
CURTAIN DRAIN
TYPICAL SECTION
15'-0"
3'-0"
Straw
EARTH
COARSE GRAVEL 3/4" to 1 1/2"
#9 WASHED GRAVEL
#46 GRAVEL 1/2" to 3/4"
4" Rigid Shale Perforated PVC collection tile SLOPE 6" in 50'
4" Rigid Shale perf. PVC Distribution Pipe Slope 3" in 50'
SECTION THRU SUBSURFACE FILTER BED
SITE PLAN
for
TERRENCE GABOR
PART of LOT 7 TRACT 6
MADISON TOWNSHIP
LAKE CO. OHIO
1" = 40' MAR. 1985
Milton A. Bornhauser
Reg. Surveyor #4247
N 86° 29' 13" W
440.00
5.038 Acres
N 3° 30' 47" E
500.00
LAKE
500' Evapo-Trans.
Inspection Ports
Curtain drain
House
G.
DRIVE
440.00
N 86° 48' 00" W
FORD ROAD 60'
Grading Plan Approved
as shown and/or noted
THOMAS P. GILLES, P.E.
Lake County Engineer
By
Date 3-19-85
APPROVED
MADISON TWP. ZONING
Permit: 11501
Zoning Inspector:
Reviewed and Accepted
LAKE COUNTY GENERAL HEALTH DISTRICT
Date 3-15-85
JOEL LUCIA, R. S., M. P. H.
Health Commissioner
BY
SEWAGE DISPOSAL PERMIT MUST BE OBTAINED BY A LAKE COUNTY LICENSED INSTALLER BEFORE INSTALLATION IS STARTED.