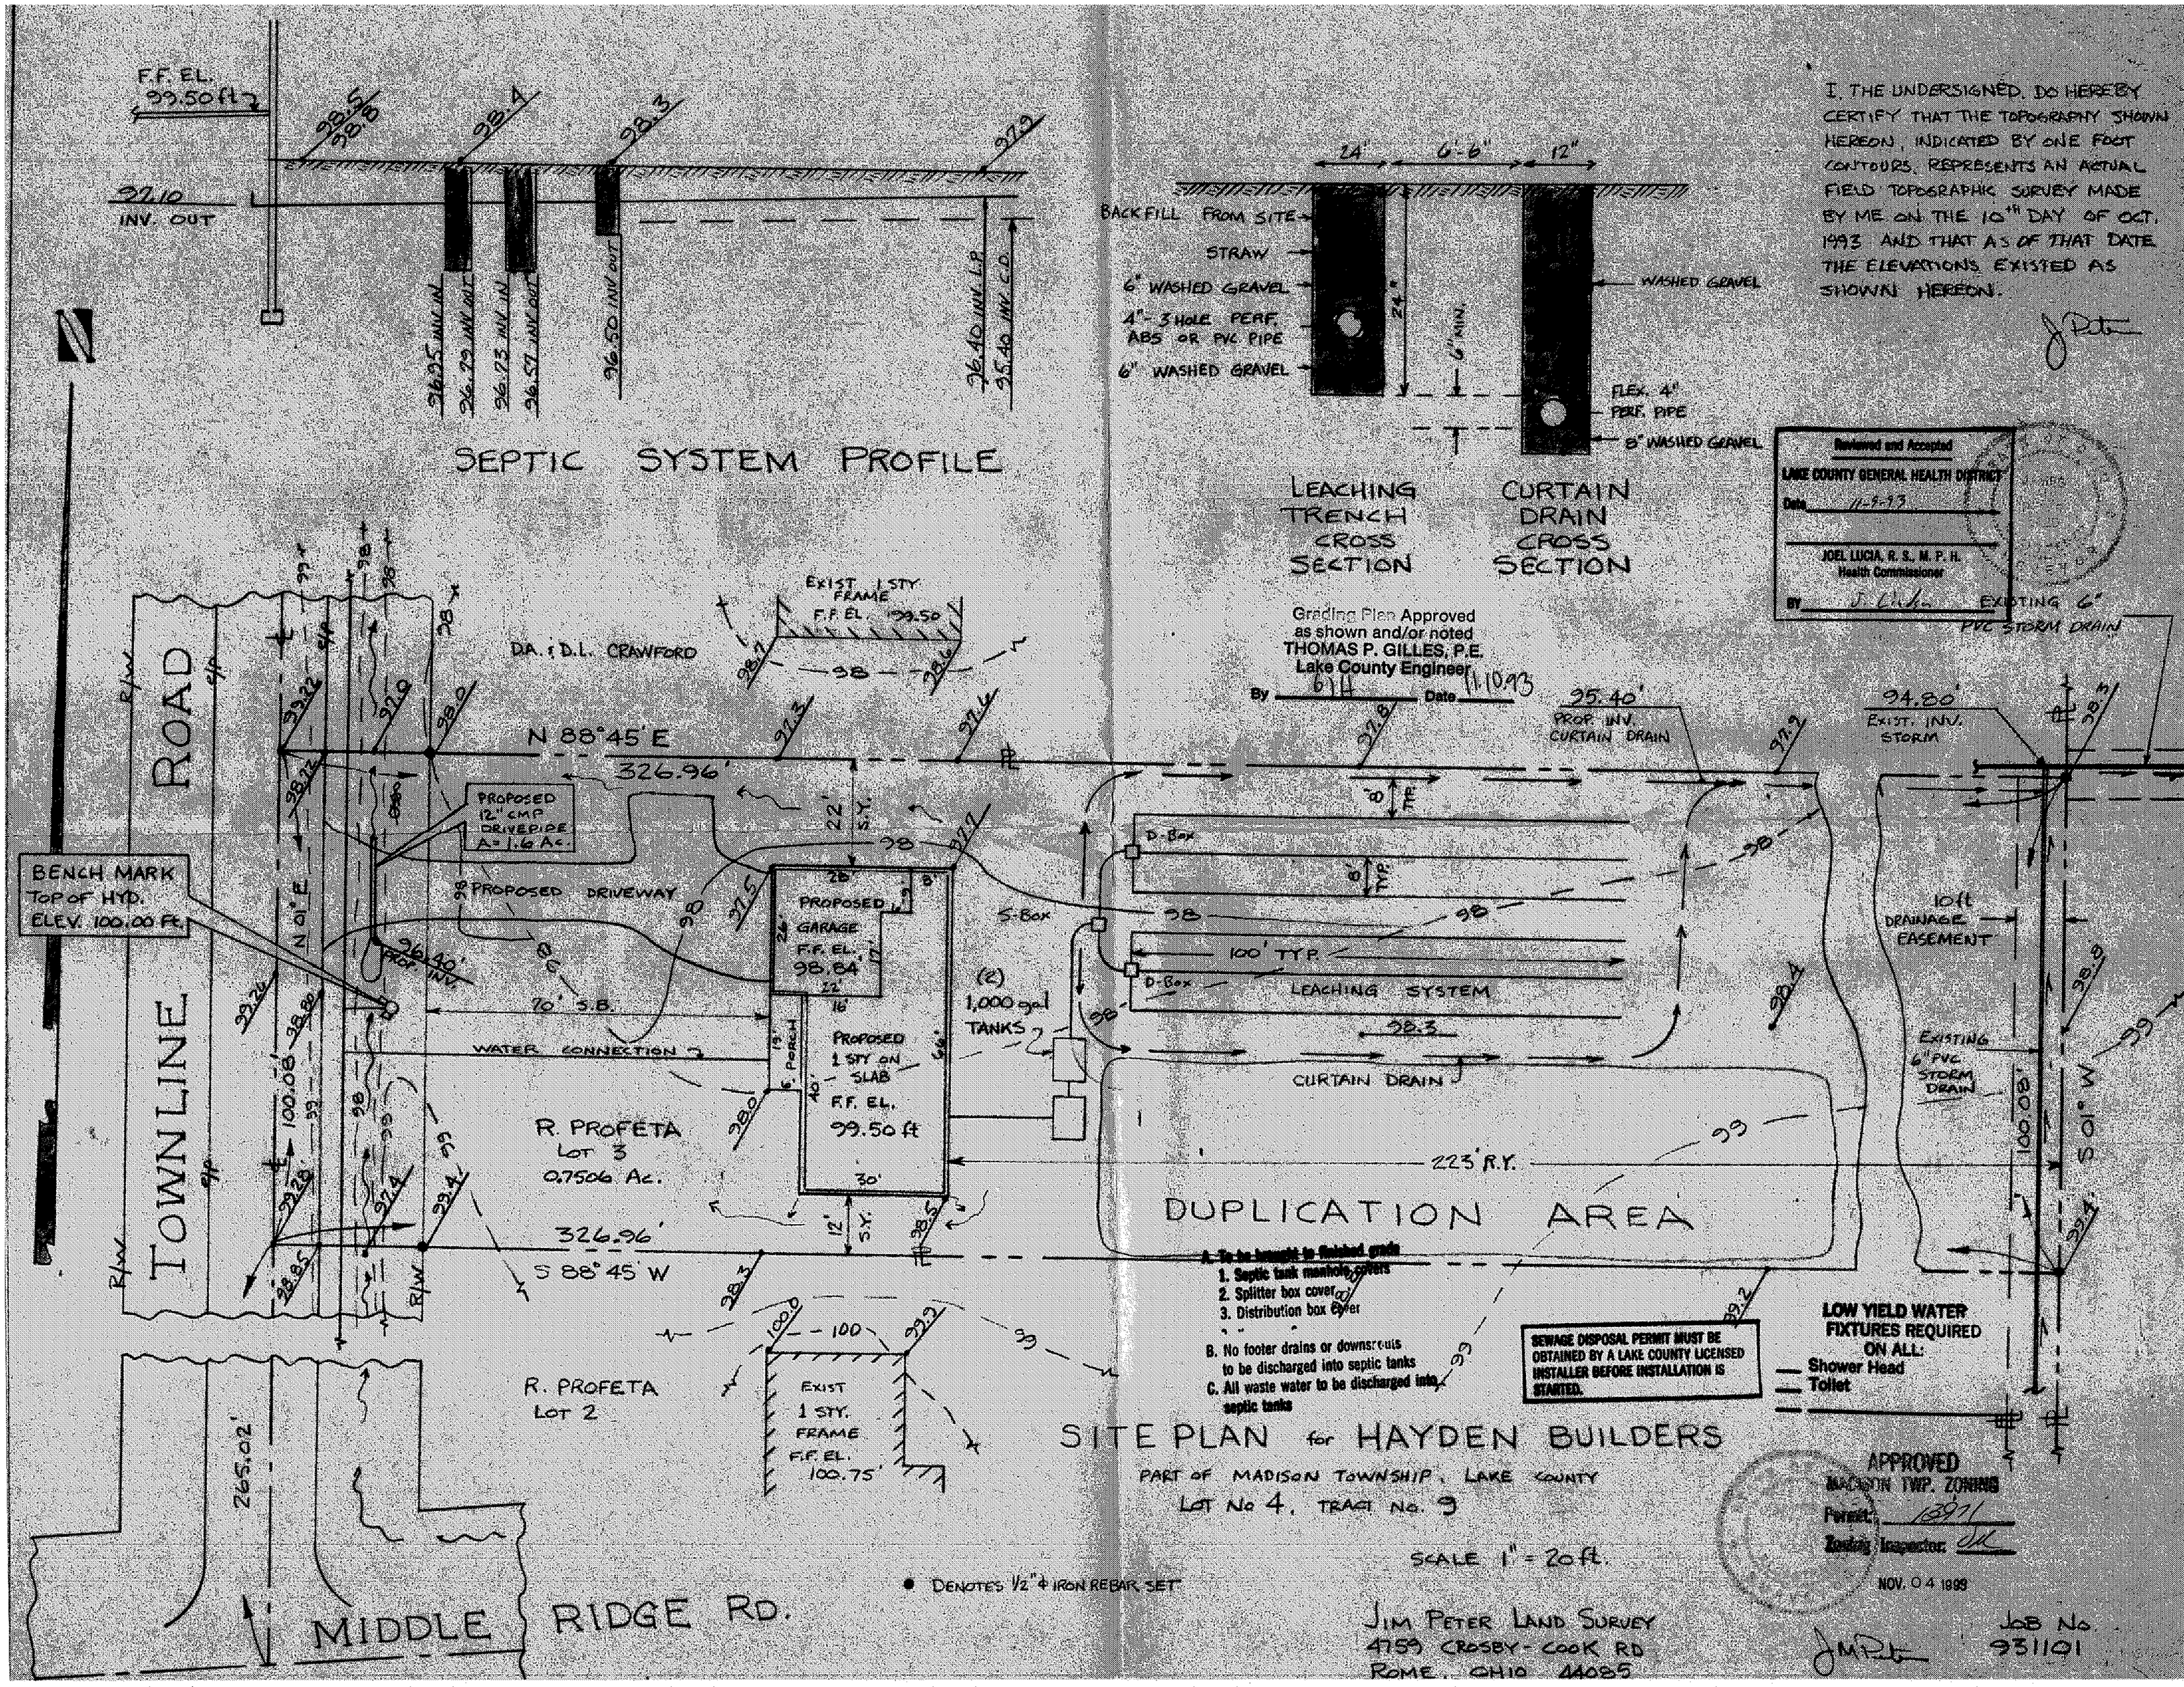

F.F. EL. 99.50 ft
97.10 INV. OUT
96.95 INV. IN
96.79 INV. OUT
96.73 INV. IN
96.57 INV. OUT
96.50 INV. OUT
96.40 INV. L.P.
95.40 INV. C.D.
SEPTIC SYSTEM PROFILE
24"
6'-6"
12"
BACKFILL FROM SITE
STRAW
6" WASHED GRAVEL
4"-3 HOLE PERF. ABS OR PVC PIPE
6" WASHED GRAVEL
WASHED GRAVEL
FLEX. 4" PERF. PIPE
8" WASHED GRAVEL
LEACHING TRENCH CROSS SECTION
CURTAIN DRAIN CROSS SECTION
I, THE UNDERSIGNED, DO HEREBY CERTIFY THAT THE TOPOGRAPHY SHOWN HEREON, INDICATED BY ONE FOOT CONTOURS, REPRESENTS AN ACTUAL FIELD TOPOGRAPHIC SURVEY MADE BY ME ON THE 10TH DAY OF OCT. 1993 AND THAT AS OF THAT DATE THE ELEVATIONS EXISTED AS SHOWN HEREON.
Reviewed and Accepted
LAKE COUNTY GENERAL HEALTH DISTRICT
Date 11-9-93
JOEL LUCIA, R. S., M. P. H.
Health Commissioner
BY
EXISTING 6" PVC STORM DRAIN
Grading Plan Approved as shown and/or noted
THOMAS P. GILLES, P.E.
Lake County Engineer
By
Date 11.10.93
EXIST. 1 STY FRAME F.F. EL. 99.50
D.A. & D.L. CRAWFORD
N 88°45' E
326.96'
PROPOSED 12" CMP DRIVEPIPE A=1.6 Ac.
PROPOSED DRIVEWAY
BENCH MARK TOP OF HYD. ELEV. 100.00 Ft.
PROPOSED GARAGE F.F. EL. 98.84
PROPOSED 1 STY ON SLAB F.F. EL. 99.50 ft
70' S.B.
WATER CONNECTION
(2) 1,000 gal TANKS
S-Box
D-Box
100' TYP.
LEACHING SYSTEM
CURTAIN DRAIN
95.40' PROP. INV. CURTAIN DRAIN
94.80' EXIST. INV. STORM
10 ft DRAINAGE EASEMENT
EXISTING 6" PVC STORM DRAIN
223' R.Y.
DUPLICATION AREA
R. PROFETA LOT 3 0.7506 Ac.
326.96'
S 88°45' W
R. PROFETA LOT 2
EXIST 1 STY. FRAME F.F. EL. 100.75'
TOWNLINE ROAD
MIDDLE RIDGE RD.
265.02'
A. To be brought to finished grade
1. Septic tank manhole covers
2. Splitter box cover
3. Distribution box cover
B. No footer drains or downspouts to be discharged into septic tanks
C. All waste water to be discharged into septic tanks
SEWAGE DISPOSAL PERMIT MUST BE OBTAINED BY A LAKE COUNTY LICENSED INSTALLER BEFORE INSTALLATION IS STARTED.
LOW YIELD WATER FIXTURES REQUIRED ON ALL:
Shower Head
Toilet
SITE PLAN for HAYDEN BUILDERS
PART OF MADISON TOWNSHIP, LAKE COUNTY
LOT No 4, TRACT No. 9
SCALE 1" = 20 ft.
• DENOTES 1/2" ϕ IRON REBAR SET
APPROVED
MADISON TWP. ZONING
Permit: 13971
Zoning Inspector:
NOV. 04 1993
JIM PETER LAND SURVEY
4759 CROSBY-COOK RD
ROME, OHIO 44085
JOB No. 931101