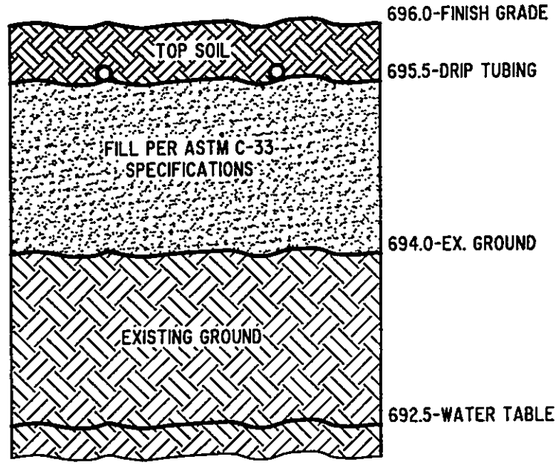

TYPICAL SECTION

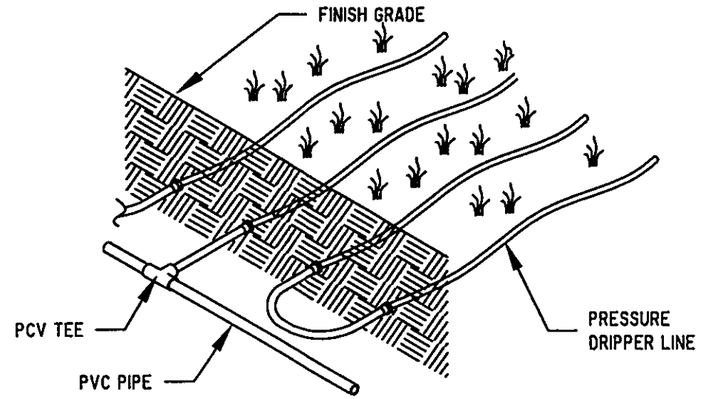

DRIPPER LINE TO FOLLOW CONTOURS WITH PVC MANIFOLD PERPENDICULAR TO GRADE. PVC MANIFOLD TO BE FREEZE PROTECTED.

SUBSURFACE DISTRIBUTION SYSTEM

SCOPE: DOMESTIC SEWAGE WILL FLOW BY GRAVITY THROUGH THE SEPTIC TANK THEN INTO A FINAL DOSING TANK. THE CENTRAL UNIT WILL DISPOSE OF THE EFFLUENT BY ALTERNATELY DOSING MULTIPLE ZONES IN THE ABSORPTION AREA.

THE CENTRAL UNIT COMPRISES BOTH THE CONTROLS AND THE HYDRAULIC UNIT.

DRIP DETAIL SCHEMATICS

** NOTE: SUPPLY AND RETUN LINES TO BE 1" SCHEDULE 40 PVC WITH PRESSURE RATED FITTINGS AND FROST PROTECTION

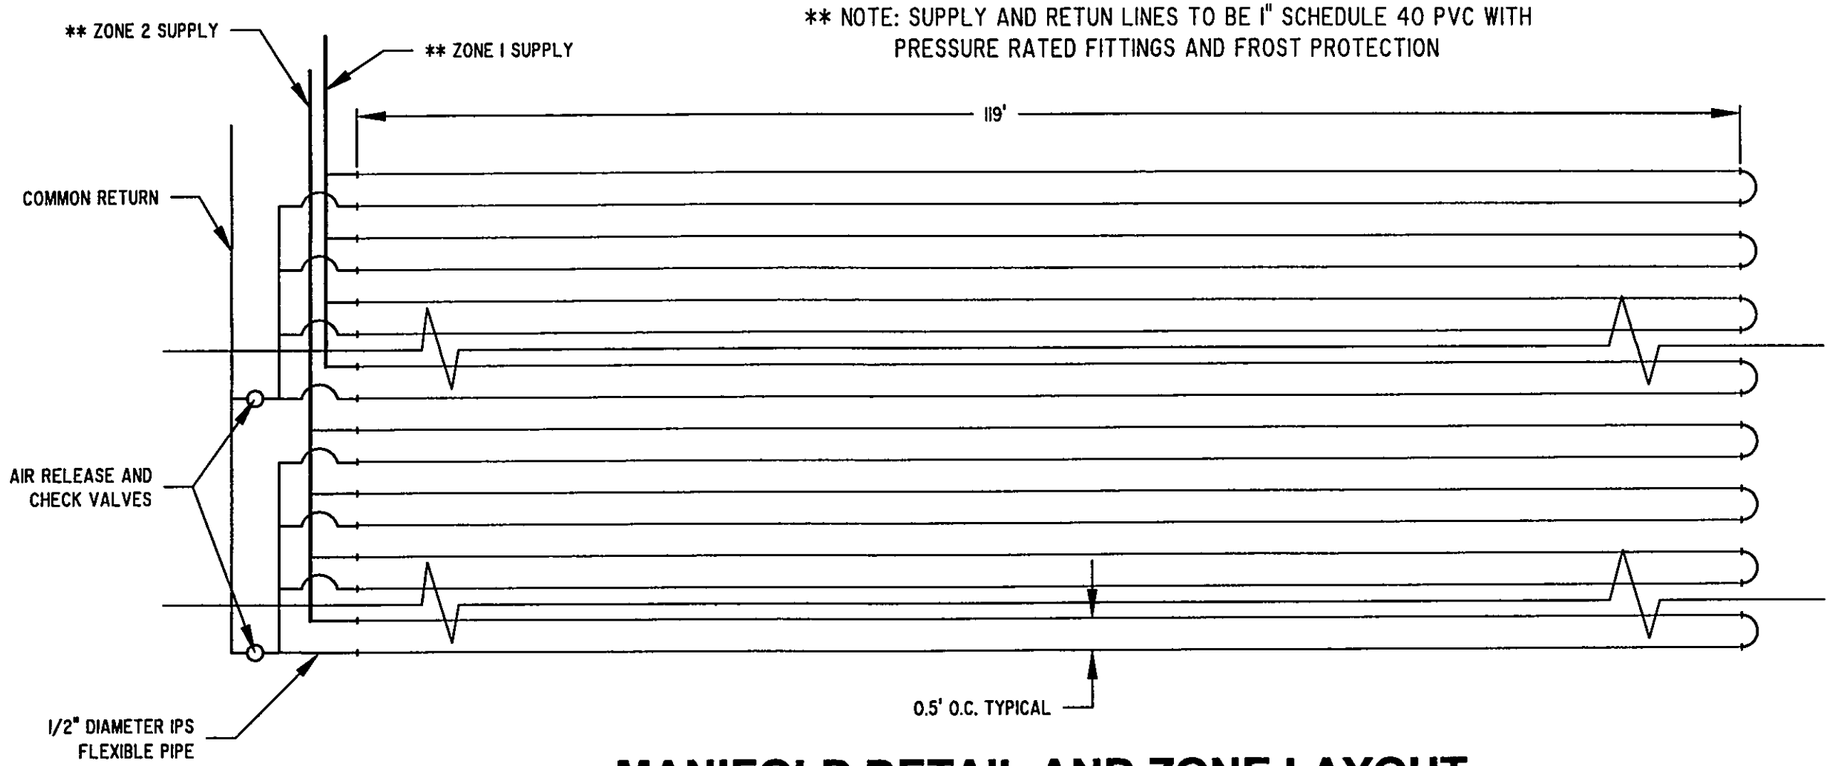

MANIFOLD DETAIL AND ZONE LAYOUT

02007-04

REVISIONS	BY
REVISED SEPTIC SEPT. 9, 2004	DWN

Barrington CONSULTING GROUP, INC.
38342 WESTERN PARKWAY, SUITE 10
WILLOUGHBY, OHIO 44094
PHONE 440.946.1761 FAX 440.918.0486

STATE OF OHIO DAVID W NOVAK S-7507 REGISTERED SURVEYOR

DETAIL
SUBLOT 04, BELLMORE ROAD, PAINESVILLE TWP.
BELLMORE SUBDIVISION

LITTLE MOUNTAIN HOMES, INC.

DRAWN WSO
CHECKED DWN
DATE AUG. 06, 2004
SCALE NONE
JOB NO. 02007-04
SHEET 5/5 OF SHEETS

W:\2002\02007\02007-04.dwg, 09/09/2004 08:52:53 AM, Copyright Barrington Consulting Group

FORM C:\SCIS\LIBRARY\FORMS\RCGA3-1.DWG