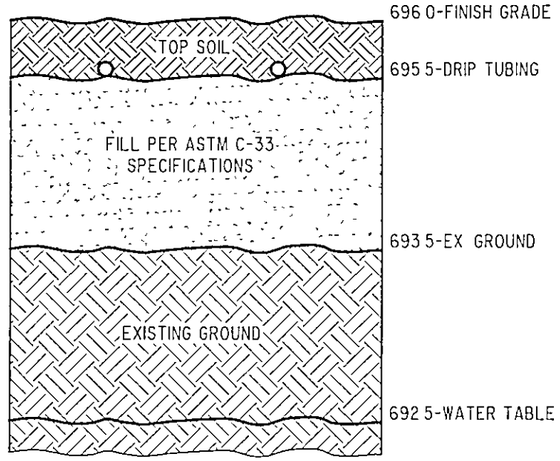

TYPICAL SECTION

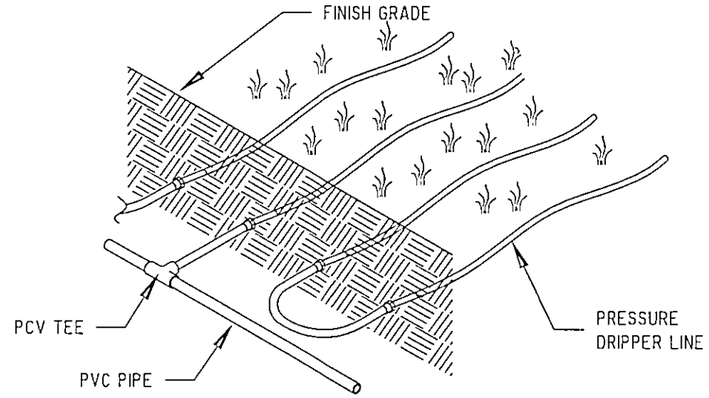

DRIPPER LINE TO FOLLOW CONTOURS WITH PVC MANIFOLD PERPENDICULAR TO GRADE PVC MANIFOLD TO BE FREEZE PROTECTED

SUBSURFACE DISTRIBUTION SYSTEM

SCOPE: DOMESTIC SEWAGE WILL FLOW BY GRAVITY THROUGH THE SEPTIC TANK THEN INTO A FINAL DOSING TANK THE CENTRAL UNIT WILL DISPOSE OF THE EFFLUENT BY ALTERNATELY DOSING MULTIPLE ZONES IN THE ABSORPTION AREA

THE CENTRAL UNIT COMPRISES BOTH THE CONTROLS AND THE HYDRAULIC UNIT

DRIP DETAIL SCHEMATICS

** NOTE: SUPPLY AND RETUN LINES TO BE 1" SCHEDULE 40 PVC WITH PRESSURE RATED FITTINGS AND FROST PROTECTION

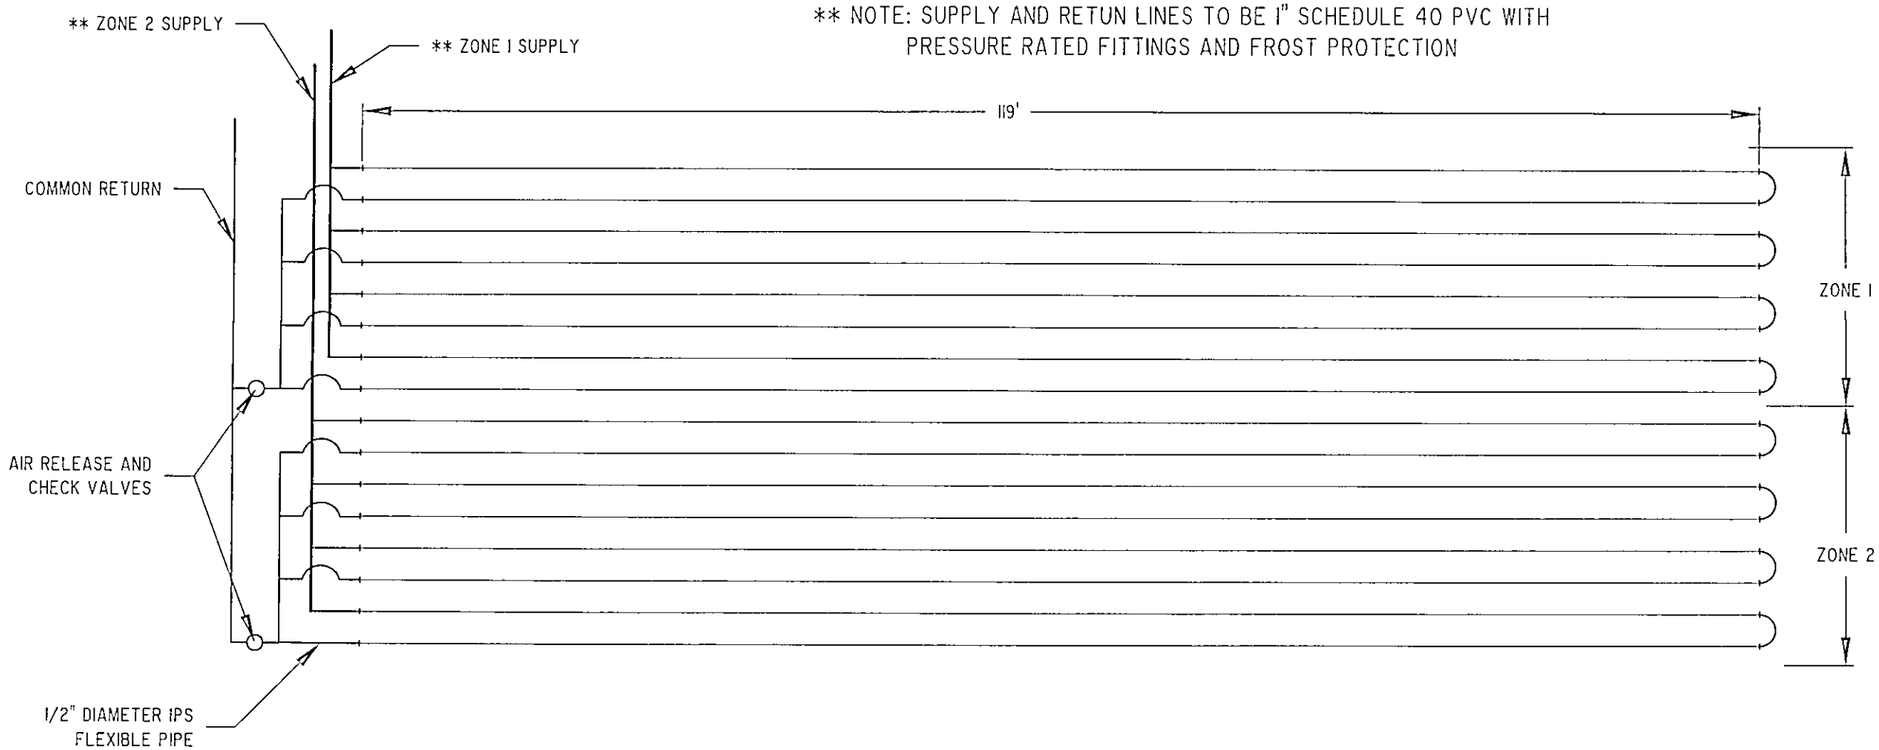

MANIFOLD DETAIL AND ZONE LAYOUT

FORM W \BLOCKS\FORMS\BCGA3-SHARP DWG

02007-06

REVISIONS	BY
REVISED SEPTIC AUG 10, 2005	WSO

Barrington CONSULTING GROUP, INC.
9114 TYLER BLVD., MENTOR, OHIO 44060
PHONE 440.205.1260 FAX 440.205.1262
BCG@BarringtonCGI.com

STATE OF OHIO DAVID W NOVAK S-7507 REGISTERED SURVEYOR

DETAILS
S/L 6 BELLMORE DR. PAINESVILLE TWP. OH. 44077
BELLMORE SUBDIVISION VOL. 44 PG. 21

LITTLE MOUNTAIN HOMES, INC.

DRAWN WSO
CHECKED DWN
DATE AUG 05, 2005
SCALE NONE
JOB NO 02007-06
SHEET 5/5 OF SHEETS

W:\2002\02007\Subdivision\02007 06.dwg 08/10/2005 03:58:04 PM Copyright Barrington Consulting Group