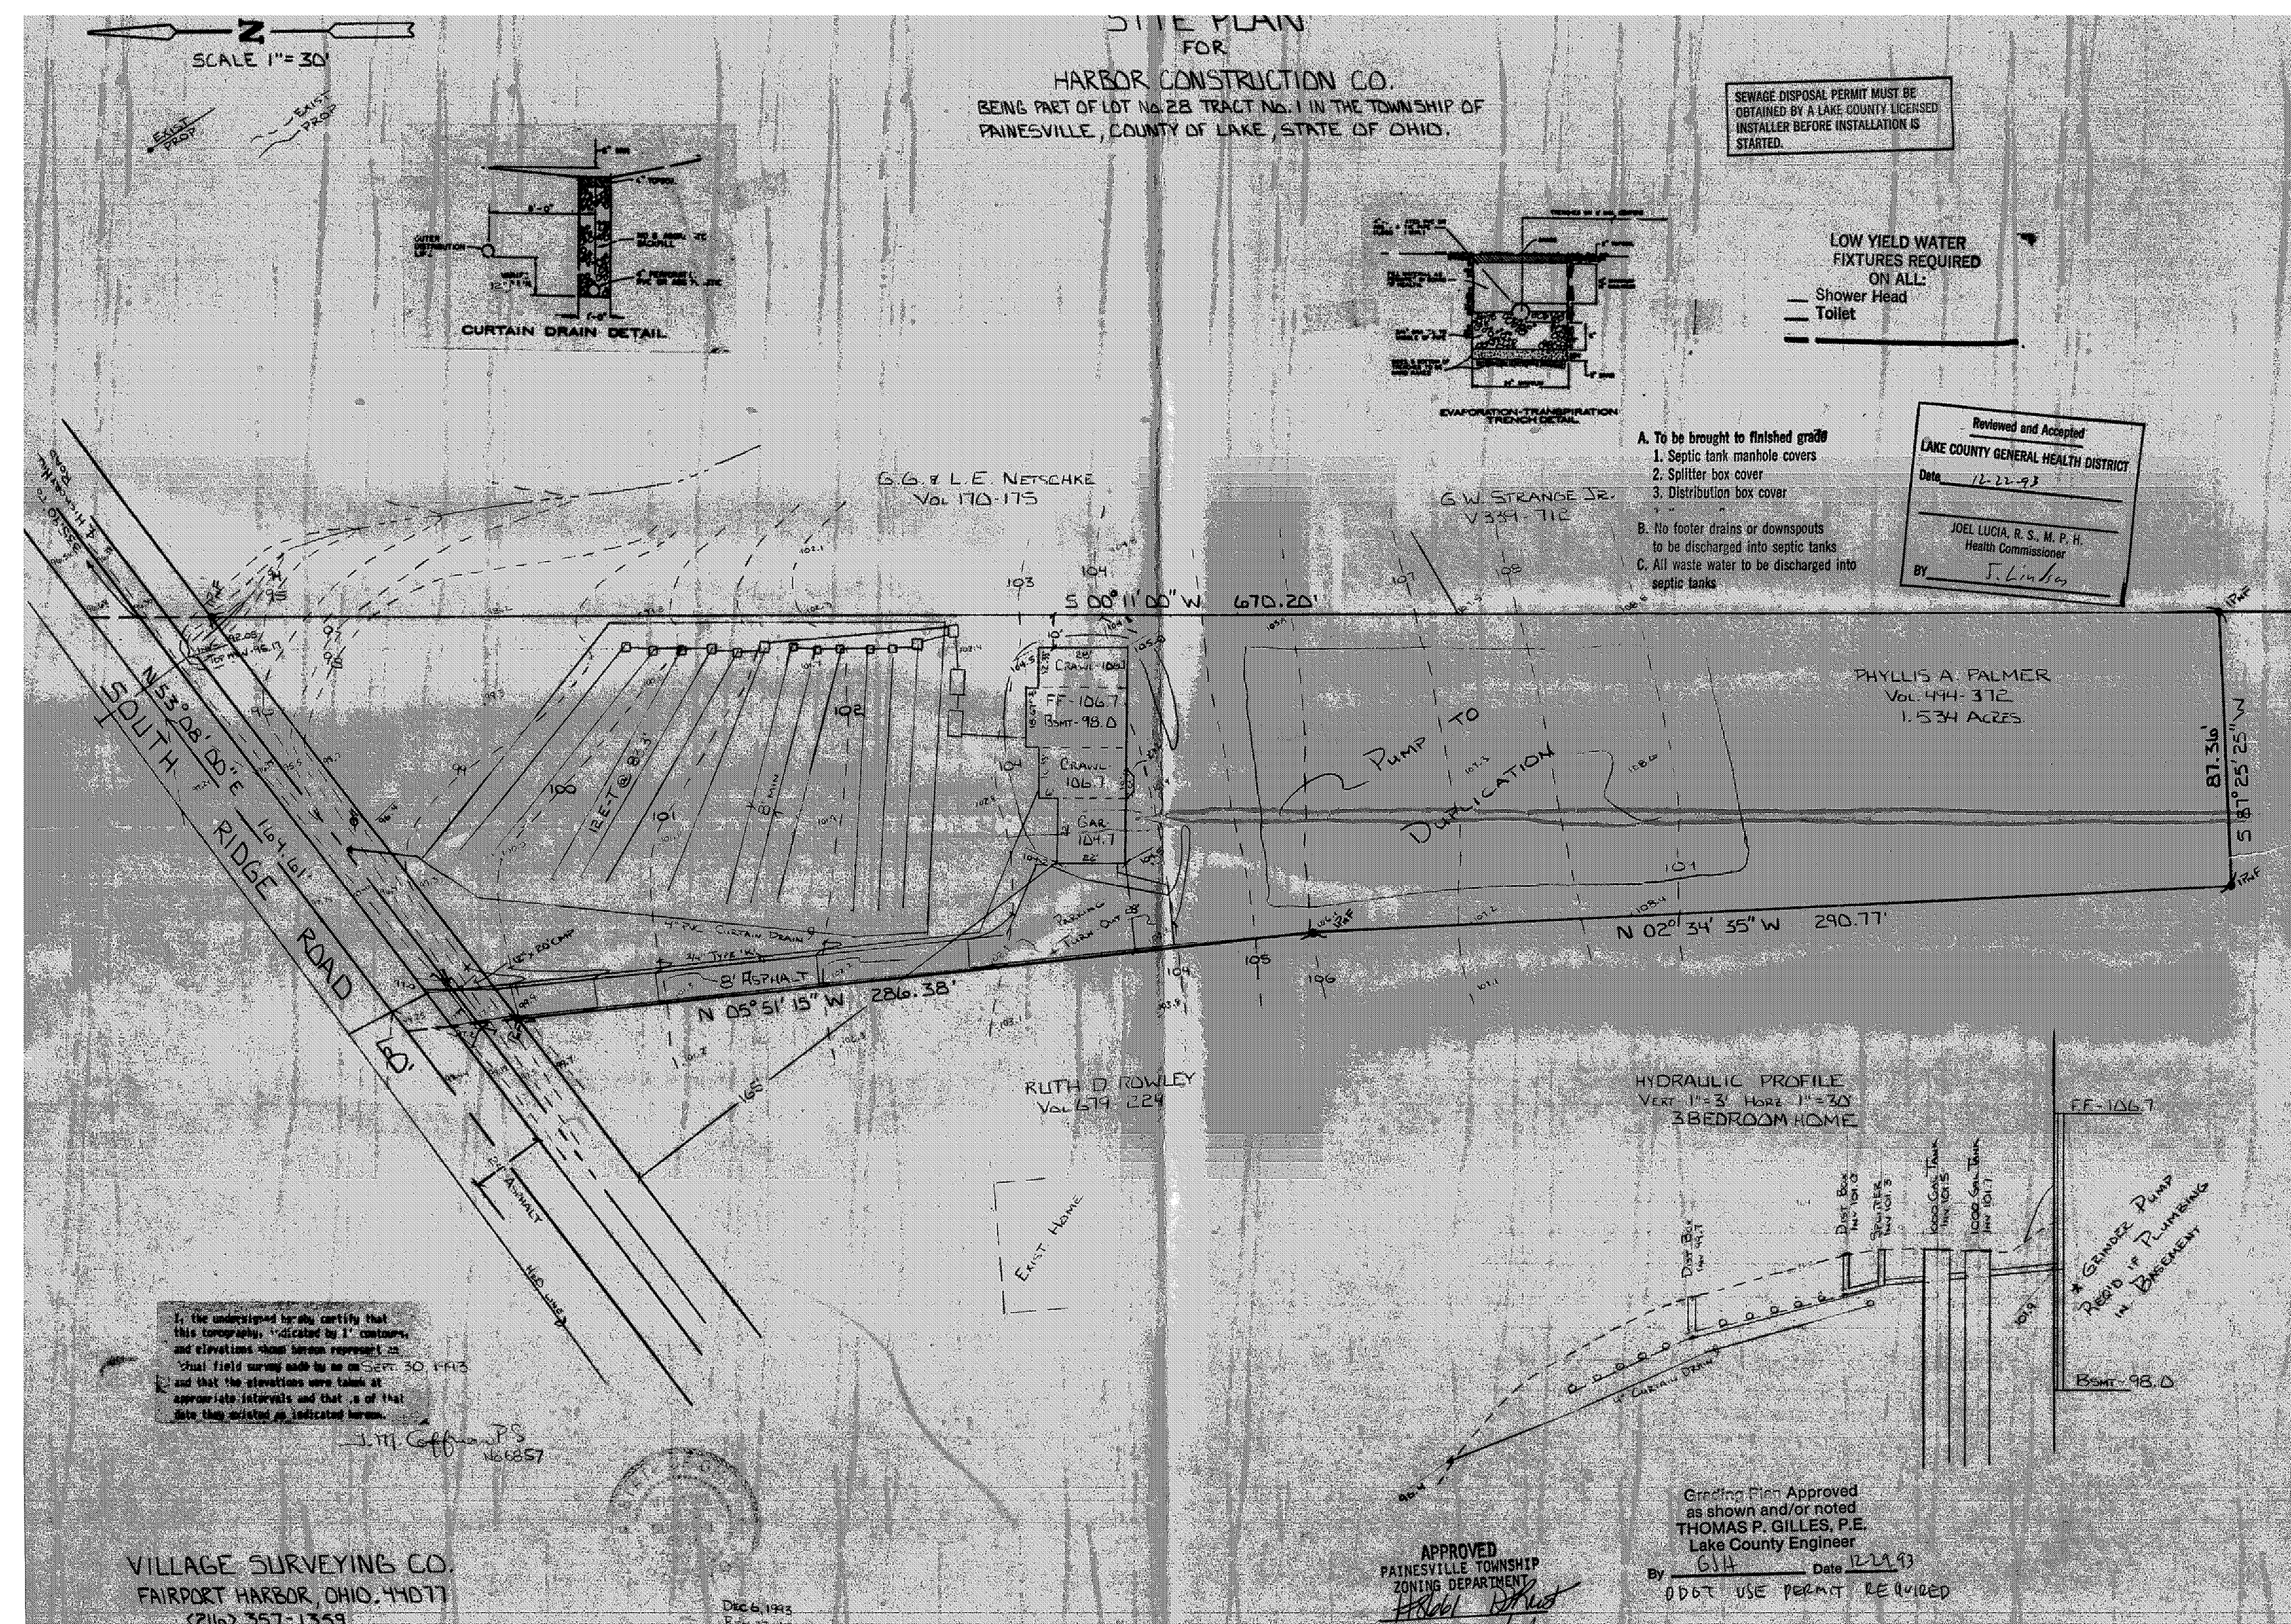

SITE PLAN
FOR
HARBOR CONSTRUCTION CO.
BEING PART OF LOT No. 28 TRACT No. 1 IN THE TOWNSHIP OF PAINESVILLE, COUNTY OF LAKE, STATE OF OHIO.
SCALE 1" = 30'
EXIST PROP
CURTAIN DRAIN DETAIL
EVAPORATION-TRANSPIRATION TRENCH DETAIL
SEWAGE DISPOSAL PERMIT MUST BE OBTAINED BY A LAKE COUNTY LICENSED INSTALLER BEFORE INSTALLATION IS STARTED.
LOW YIELD WATER FIXTURES REQUIRED ON ALL:
Shower Head
Toilet
A. To be brought to finished grade
1. Septic tank manhole covers
2. Splitter box cover
3. Distribution box cover
B. No footer drains or downspouts to be discharged into septic tanks
C. All waste water to be discharged into septic tanks
Reviewed and Accepted
LAKE COUNTY GENERAL HEALTH DISTRICT
Date 12-22-93
JOEL LUCIA, R. S., M. P. H.
Health Commissioner
BY J. Lindsay
G.G. & L.E. NETSCHKE
Vol 170-175
G.W. STRANGE JR.
V339-712
S 00° 11' 00" W 670.20'
PHYLLIS A. PALMER
Vol. 494-372
1.534 ACRES
PUMP TO DUPLICATION
N 53° 08' 00" E
SOUTH RIDGE ROAD
N 05° 51' 15" W 286.38'
N 02° 34' 35" W 290.77'
S 87° 25' 25" W
87.36'
8' ASPHALT
RUTH D. ROWLEY
Vol 679-224
EXIST HOME
HYDRAULIC PROFILE
VERT 1" = 3' HORZ 1" = 30'
3 BEDROOM HOME
FF-106.7
BSMT-98.0
GRINDER PUMP REQ'D IF PLUMBING IN BASEMENT
I, the undersigned hereby certify that this topography, indicated by 1' contours, and elevations shown hereon represent an actual field survey made by me on Sept. 30, 1993 and that the elevations were taken at appropriate intervals and that as of that date they existed as indicated hereon.
J. M. Coffman P.S. No 6857
VILLAGE SURVEYING CO.
FAIRPORT HARBOR, OHIO. 44077
(216) 357-1359
Dec 6, 1993
APPROVED
PAINESVILLE TOWNSHIP
ZONING DEPARTMENT
Grading Plan Approved as shown and/or noted
THOMAS P. GILLES, P.E.
Lake County Engineer
By GJH Date 12-29-93
ODOT USE PERMIT REQUIRED