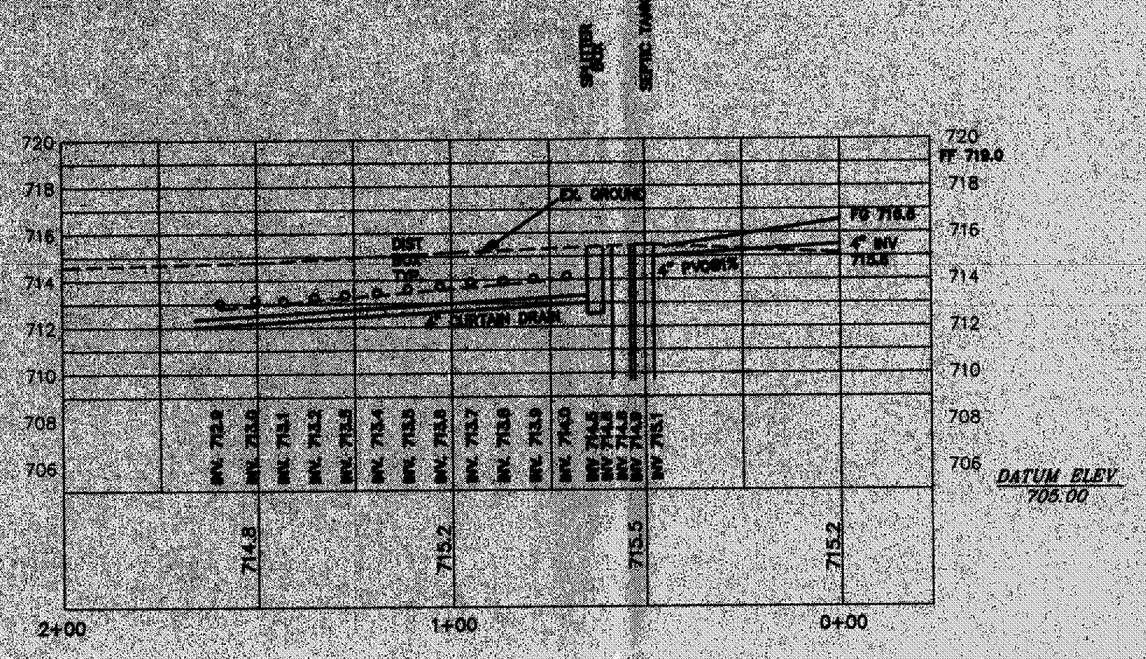

SEPTIC PROFILE

HOR. SCALE: 1" = 30'
VERT. SCALE: 1" = 5'

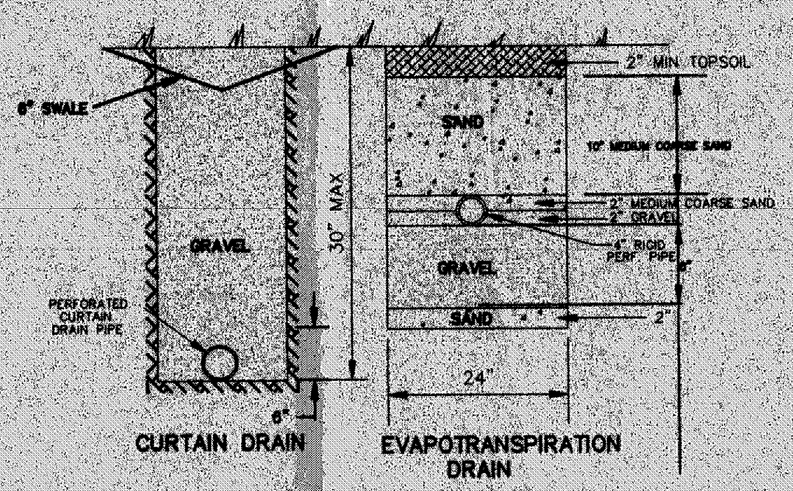

TRENCH DETAIL
NOT TO SCALE

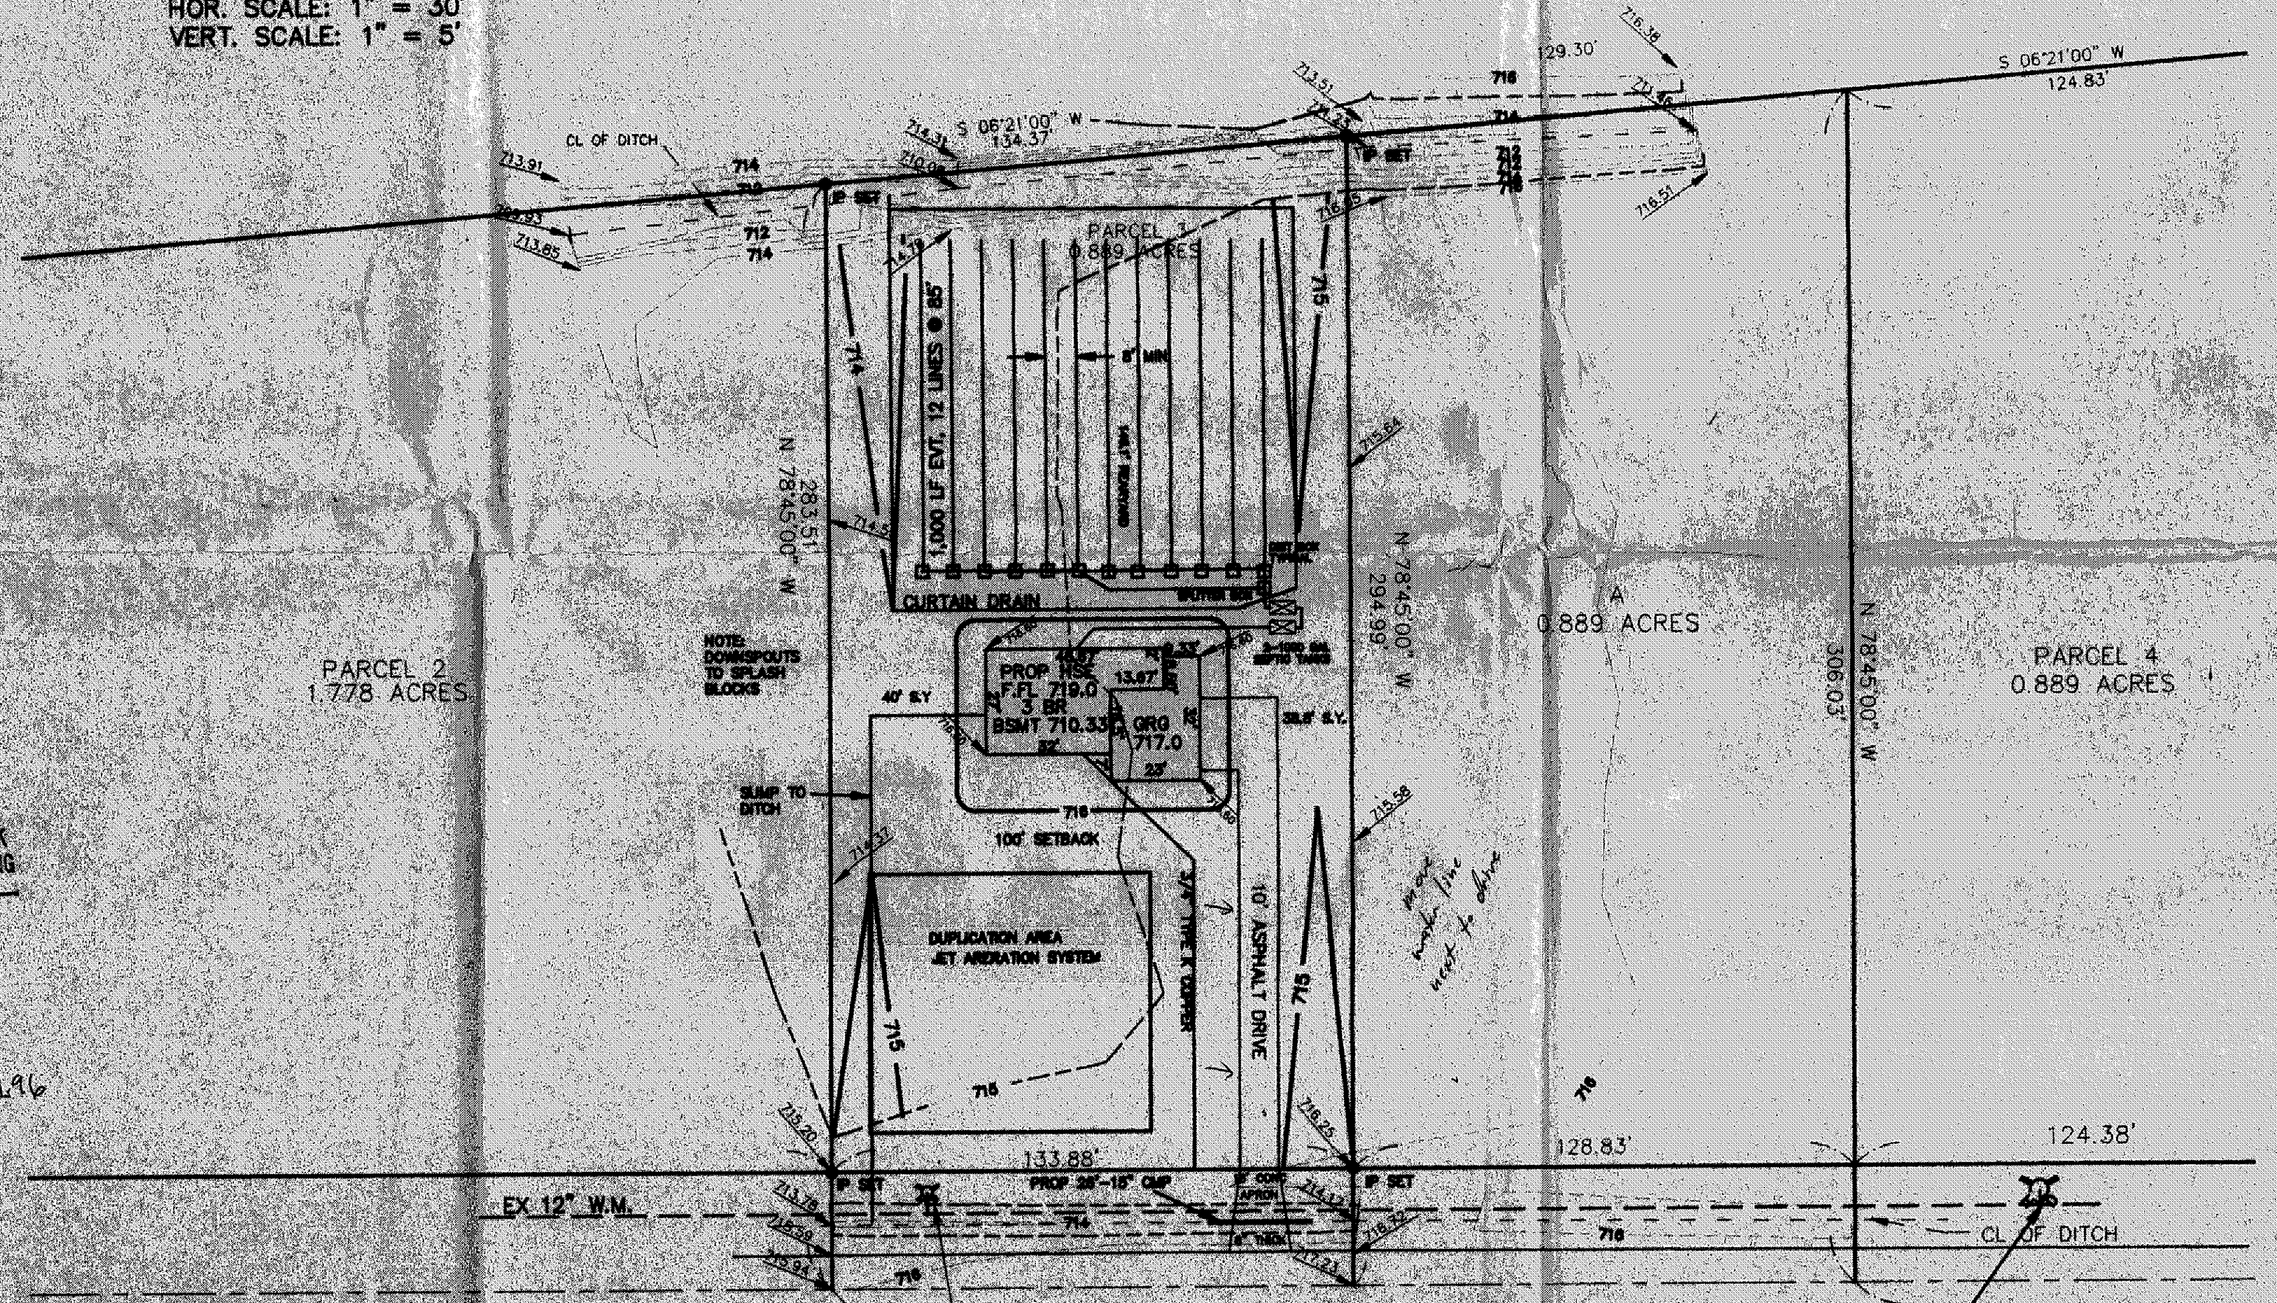

NOTE: DOWNSPOUTS TO SPLASH BLOCKS

BENCHMARK
TOP STEM OF HYDRANT
ELEV = 719.77

SEWAGE DISPOSAL PERMIT MUST BE OBTAINED BY A LAKE COUNTY LICENSED INSTALLER BEFORE INSTALLATION IS STARTED.

LOW YIELD WATER FIXTURES REQUIRED ON ALL:
— Shower Head
— Toilet
— —

A. To be brought to finished grade
1. Septic tank manhole covers
2. Splitter box cover
3. Distribution box cover
" "
B. No footer drains or downspouts to be discharged into septic tanks
C. All waste water to be discharged into septic tanks

Reviewed and Accepted
LAKE COUNTY GENERAL HEALTH DISTRICT
Date 3-20-96
mor water line
JOEL LUCIA, R.S., M.P.H.
Health Commissioner
BY J. Lindsay

APPROVED
SIDE LINES & SET BACK
PERRY TOWNSHIP ZONING
PERMIT NO. 625
ZONING INSPECTOR

Erosion Plan Approved
as shown and/or noted
THOMAS P. GILLES, P.E.
County Engineer
BY GJH Date 3.7.96

"I, the undersigned hereby certify that this topography, indicated by 6", 1' or 2' contours, and elevations shown hereon represent an actual survey field survey made by me on the 14th day of Feb, 1996 and that the elevations were taken at appropriate intervals and that as of that date they existed as indicated hereon."

JF Topolski PE 44513
Registered Surveyor

I CERTIFY THAT THIS PLAN WAS PREPARED BY ME AND IS CORRECT TO THE BEST OF MY KNOWLEDGE AND BELIEF.

JF Topolski 3.19.96

NORTH

STATE OF OHIO
JOHN FRANK TOPOLSKI
44513
REGISTERED PROFESSIONAL SURVEYOR

NO.	DATE	DESCRIPTION	BY
2	3/96	PER HEALTH DEPARTMENT NOTES	SRL
1	3/96	PER HEALTH DEPARTMENT NOTES	SRL

SITE PLAN FOR: RICK MCCULLOUGH
BEING A PART OF LOT 32, VOLUME 531
PAGE 224 OF THE L.C.R.D
TOWNSHIP OF PERRY
COUNTY OF LAKE
STATE OF OHIO

5941 HEISLEY ROAD MENTOR OHIO 44060
216-639-9960 FAX 639-9970
AZTECH
ENGINEERING and SURVEYING
Civil Engineering · Land Surveying

SCALE	KEY SCALE	DATE	DRAWING NO.	SHEET
1" = 30'	1" = 5'	3/96	A21-175	1 OF 1

DRAWN BY	CHECKED BY	JOB NO.
SRL	JFT	96217