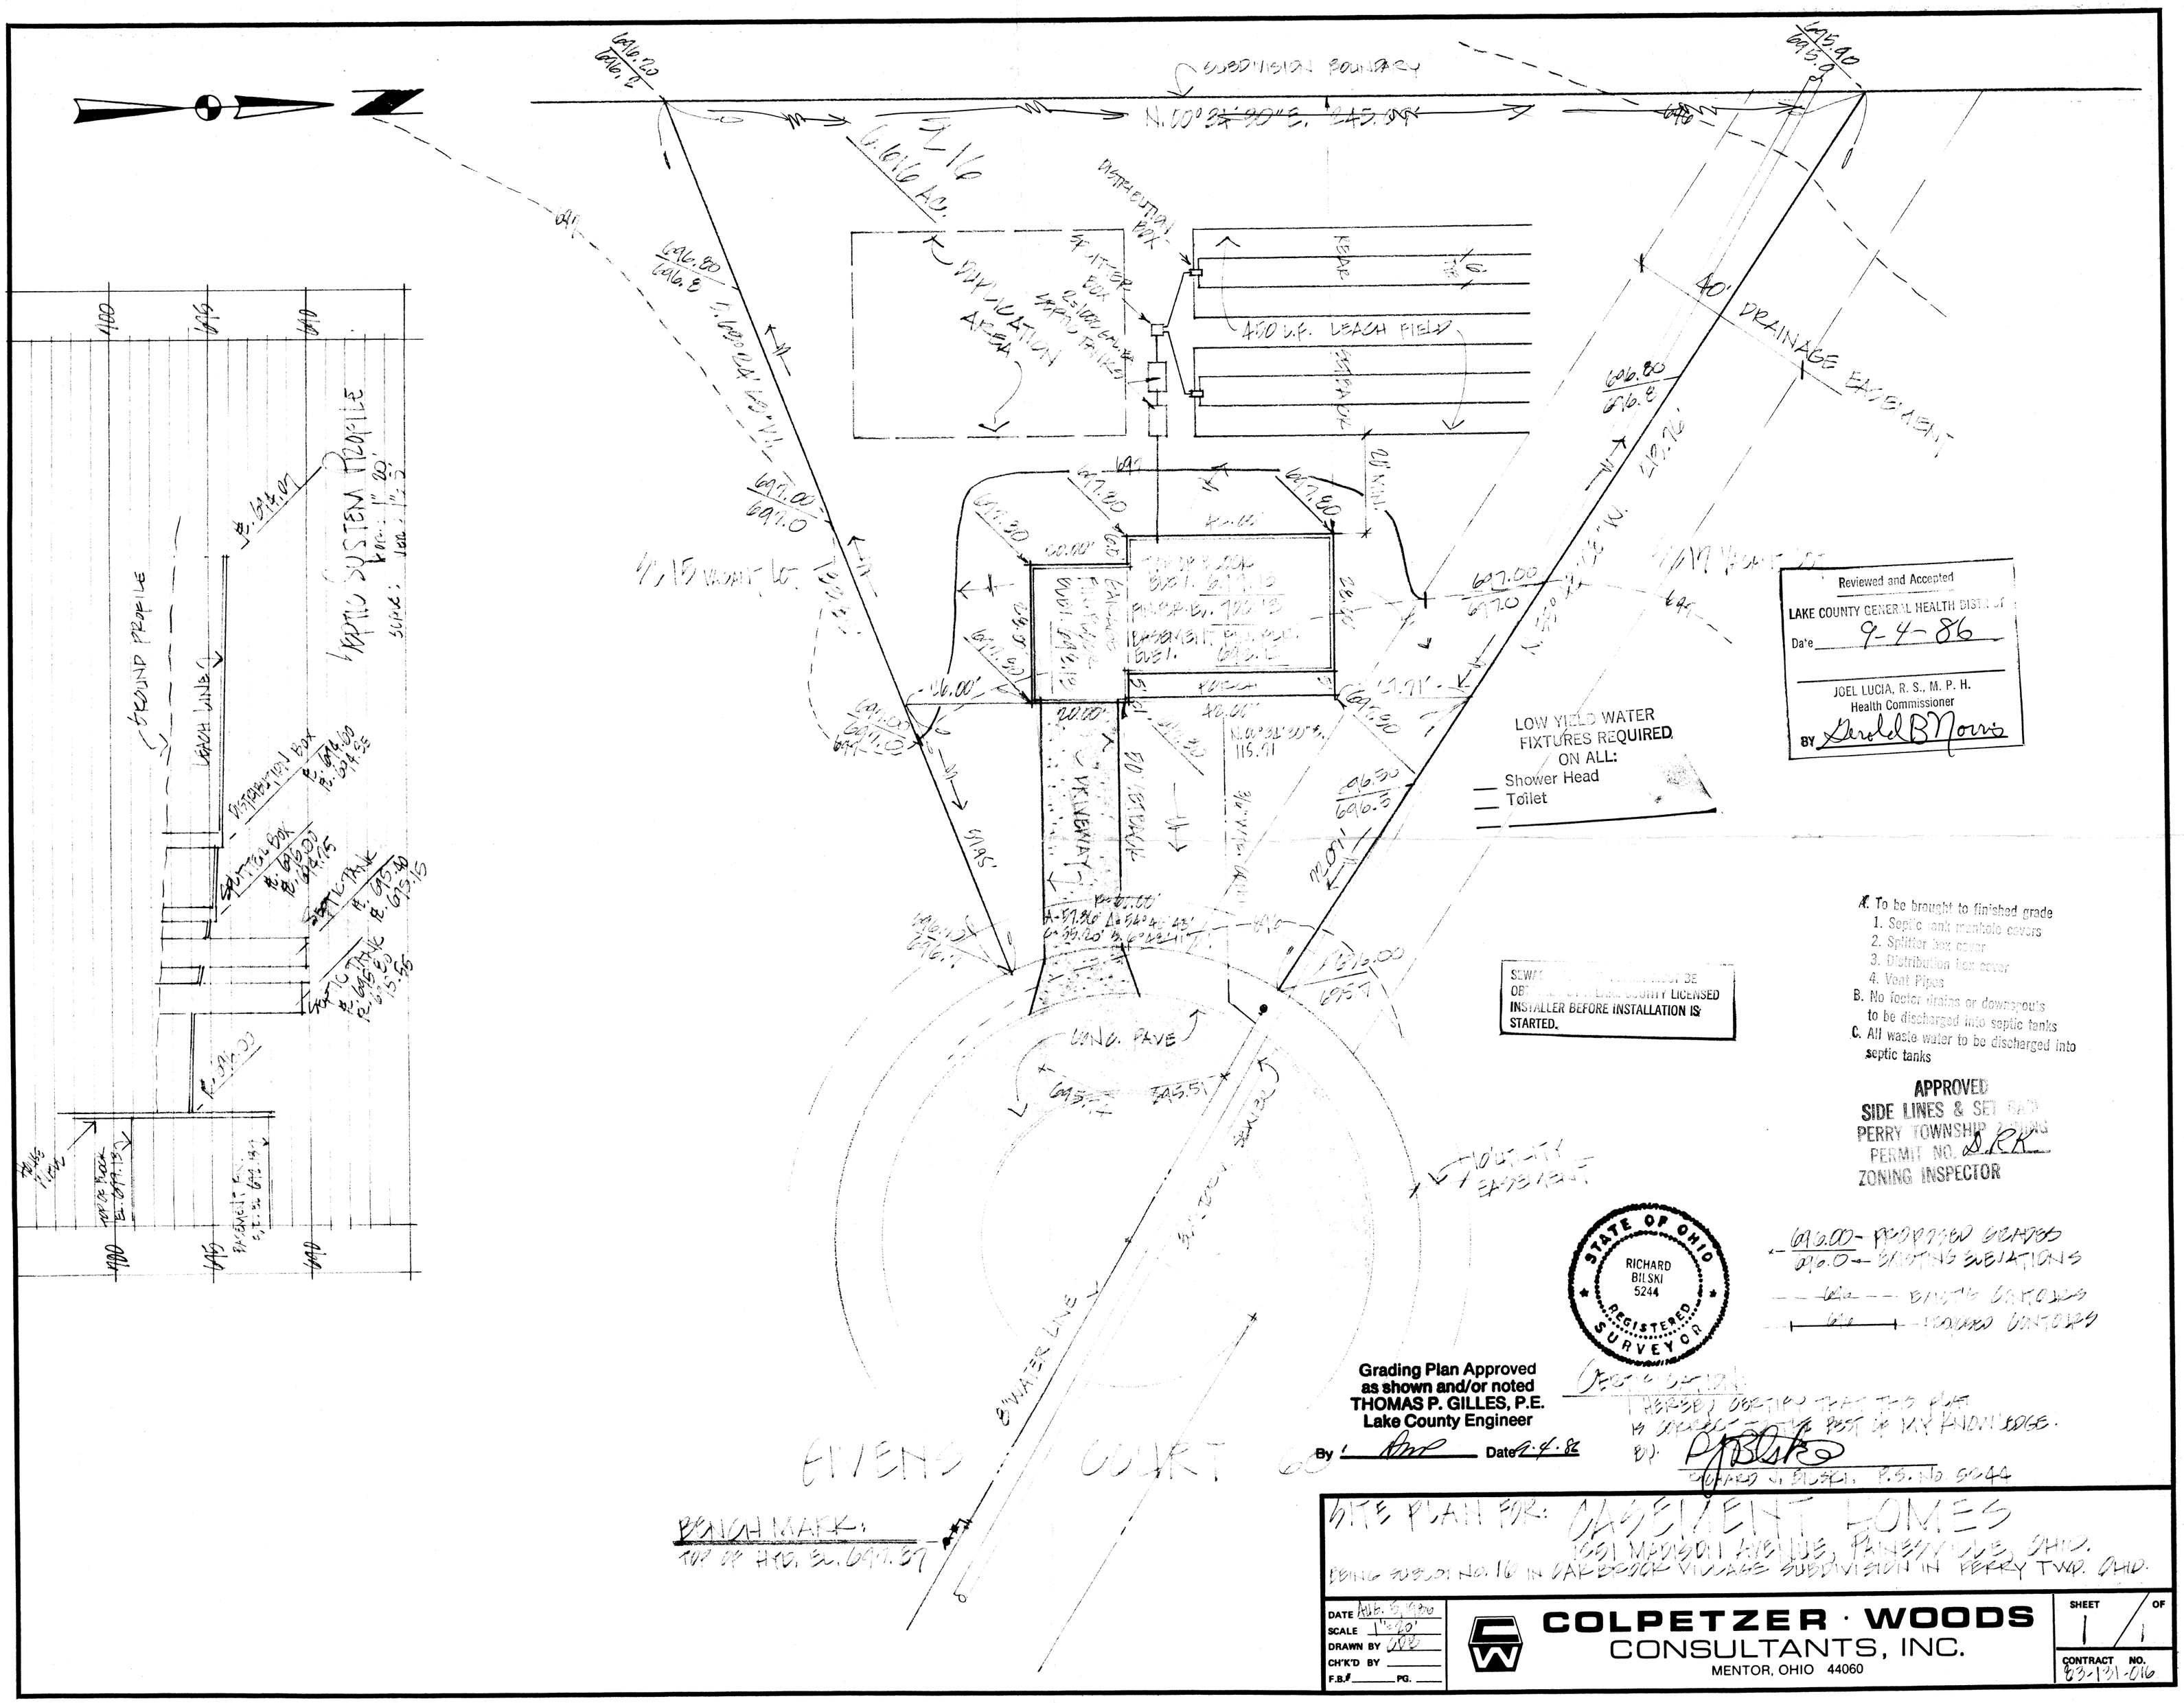
SUBDIVISION BOUNDARY
N.00°32'00"E. 245.00'
DISTRIBUTION BOX
SPLITTER BOX
450 L.F. LEACH FIELD
40' DRAINAGE EASEMENT
20' MIN.
LOW YIELD WATER FIXTURES REQUIRED ON ALL:
Shower Head
Toilet
Reviewed and Accepted
LAKE COUNTY GENERAL HEALTH DISTRICT
Date 9-4-86
JOEL LUCIA, R. S., M. P. H.
Health Commissioner
BY Gerald B Morris
SEWAGE SYSTEM PROFILE
GROUND PROFILE
LEACH LINES
DISTRIBUTION BOX
SEPTIC TANK
SEWAGE SYSTEM
SEWER MUST BE OBTAINED FROM LAKE COUNTY LICENSED INSTALLER BEFORE INSTALLATION IS STARTED.
A. To be brought to finished grade
1. Septic tank manhole covers
2. Splitter box cover
3. Distribution box cover
4. Vent Pipes
B. No footer drains or downspouts to be discharged into septic tanks
C. All waste water to be discharged into septic tanks
APPROVED
SIDE LINES & SET BACK
PERRY TOWNSHIP ZONING
PERMIT NO. S.R.K.
ZONING INSPECTOR
STATE OF OHIO
RICHARD BILSKI
5244
REGISTERED
SURVEYOR
616.00 - PROPOSED GRADES
616.0 - EXISTING ELEVATIONS
EXISTING CONTOURS
PROPOSED CONTOURS
Grading Plan Approved as shown and/or noted
THOMAS P. GILLES, P.E.
Lake County Engineer
By
Date 8-4-86
I HEREBY CERTIFY THAT THIS PLAN IS CORRECT TO THE BEST OF MY KNOWLEDGE.
BY: RICHARD J. BILSKI, P.S. NO. 5244
EIVENS COURT
BENCH MARK:
TOP OF HYD. EL. 647.59
SITE PLAN FOR: CASSIDENT HOMES
1681 MADISON AVENUE, PAINESVILLE, OHIO.
BEING SUBD. NO. 16 IN OAKBROOK VILLAGE SUBDIVISION IN PERRY TWP. OHIO.
DATE
SCALE 1"=40'
DRAWN BY
CH'K'D BY
F.B.# PG.
COLPETZER · WOODS
CONSULTANTS, INC.
MENTOR, OHIO 44060
SHEET 1 OF 1
CONTRACT NO. 83-131-016