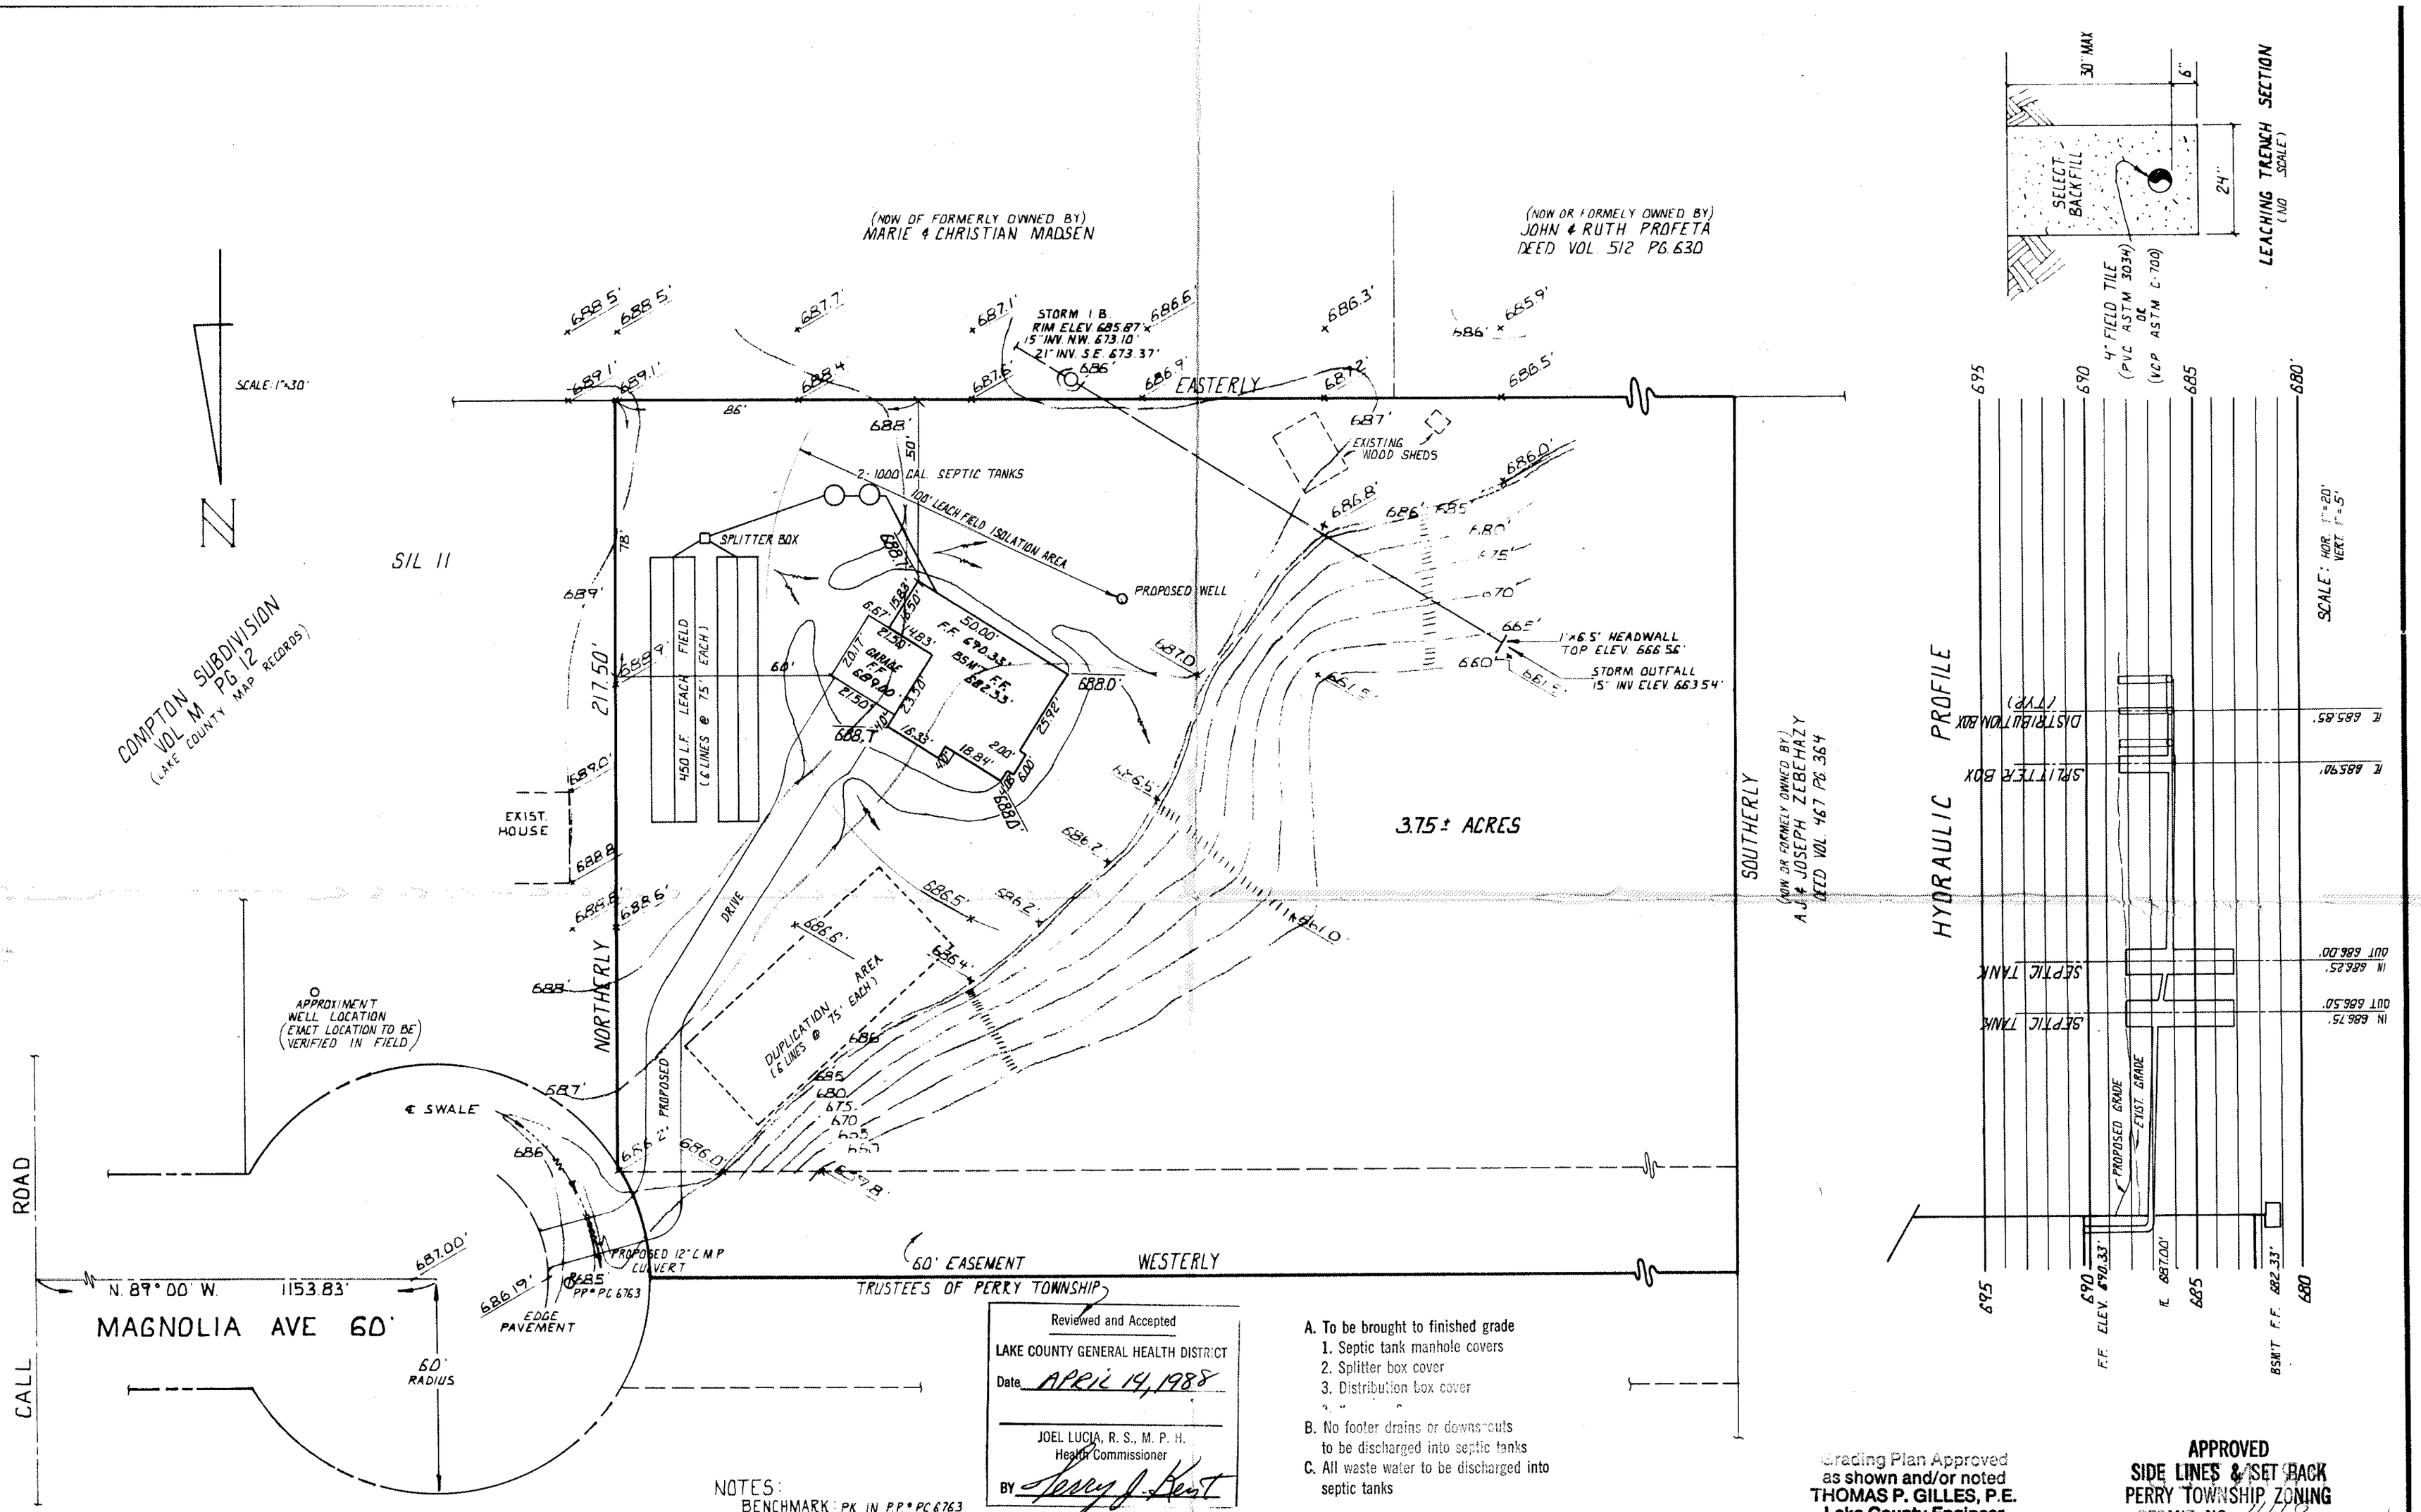

Reviewed and Accepted
LAKE COUNTY GENERAL HEALTH DISTRICT
Date APRIL 14, 1988
JOEL LUCIA, R. S., M. P. H.
Health Commissioner
BY Terry J. Keist

A. To be brought to finished grade
1. Septic tank manhole covers
2. Splitter box cover
3. Distribution box cover

B. No footer drains or downspouts to be discharged into septic tanks

C. All waste water to be discharged into septic tanks

Grading Plan Approved
as shown and/or noted
THOMAS P. GILLES, P.E.
Lake County Engineer
By _____ Date 4-25-88

APPROVED
SIDE LINES & SET BACK
PERRY TOWNSHIP ZONING
PERMIT NO. 418
ZONING INSPECTOR Don King

NOTES:
BENCHMARK: PK. IN P.P.* PC 6763
ASSUMED ELEVATION: 687.41'

ELEVATIONS: EXISTING × PROPOSED

CONTOURS: EXISTING — — — PROPOSED ~~~~

LOW YIELD WATER FIXTURES REQUIRED ON ALL:
Shower Head
Toilet

SEWAGE DISPOSAL PERMIT MUST BE OBTAINED BY A LAKE COUNTY LICENSED INSTALLER BEFORE INSTALLATION IS STARTED.

CERTIFICATION
THIS PLAT WAS PREPARED BY ME, AND IS CORRECT TO THE BEST OF MY KNOWLEDGE AND BELIEF.
REG. SURVEYOR NO. 5244
DATE: 4-11-88

STATE OF OHIO
RICHARD BILSKI
5244
REGISTERED SURVEYOR

SITE PLAN
for
JOHN BROWN
BEING PART OF LOT NO. 84
PERRY TOWNSHIP, LAKE COUNTY, OHIO

DATE 4-7-88
SCALE 1"=30'
DRAWN BY D.A.G.
CH'K'D BY
F.B.# 646 PG. 3

COLPETZER-THOMAS, INC.
AN ENGINEERING GROUP
WILLOUGHBY • MENTOR • NORTH CANTON • STEUBENVILLE • LORAIN

SHEET 1 OF 1
CONTRACT NO. 88-222