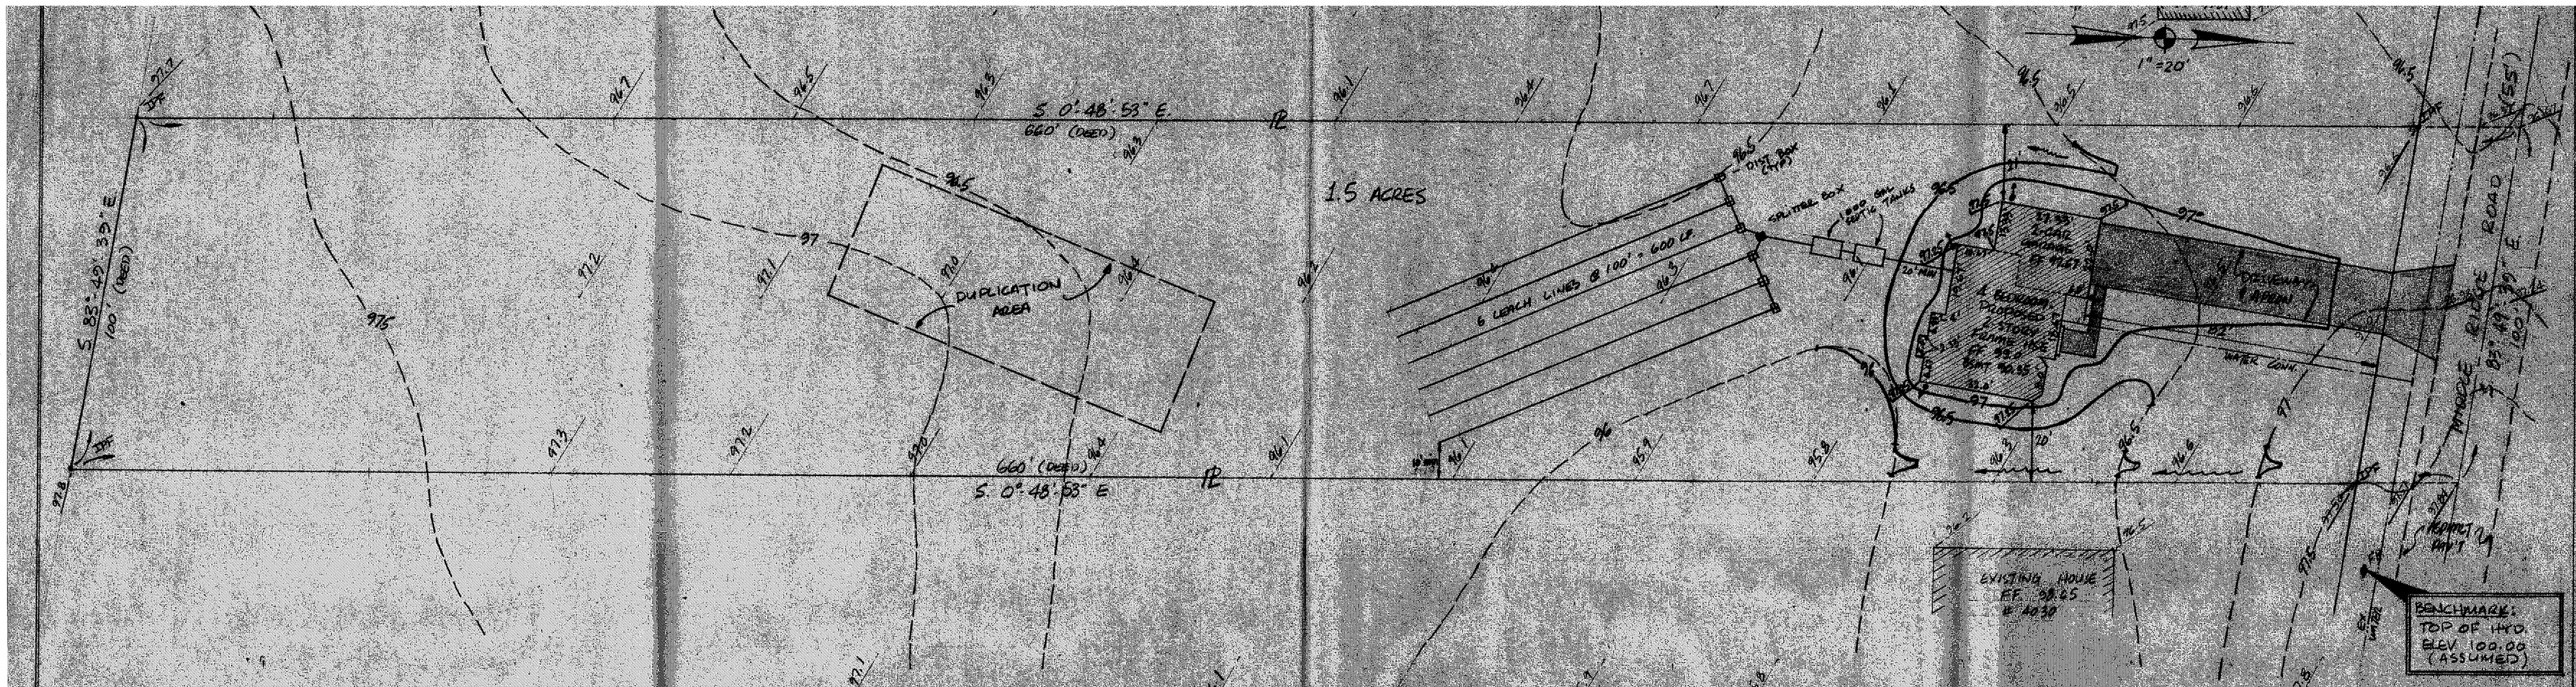

APPROVED
SIDE LINES & SET BACK
PERRY TOWNSHIP ZONING
PERMIT NO. 6272
ZONING INSPECTOR

I, THE UNDERSIGNED HEREBY CERTIFY THAT THE TOPOGRAPHY SHOWN HEREON, INDICATED BY ½ FOOT CONTOURS AND ELEVATIONS REPRESENTS AN ACTUAL FIELD TOPOGRAPHIC SURVEY MADE BY ME ON THE 24th DAY OF FEBRUARY, 1996 AND THAT THE ELEVATIONS WERE TAKEN AT APPROPRIATE INTERVALS AND THAT AS OF THAT DATE THEY EXISTED AS INDICATED HEREON."

Clyde Hadden PE — 54964
REGISTERED ENGINEER — REG NO

STATE OF OHIO · CLYDE C. HADDEN · E-54964 · REGISTERED PROFESSIONAL ENGINEER

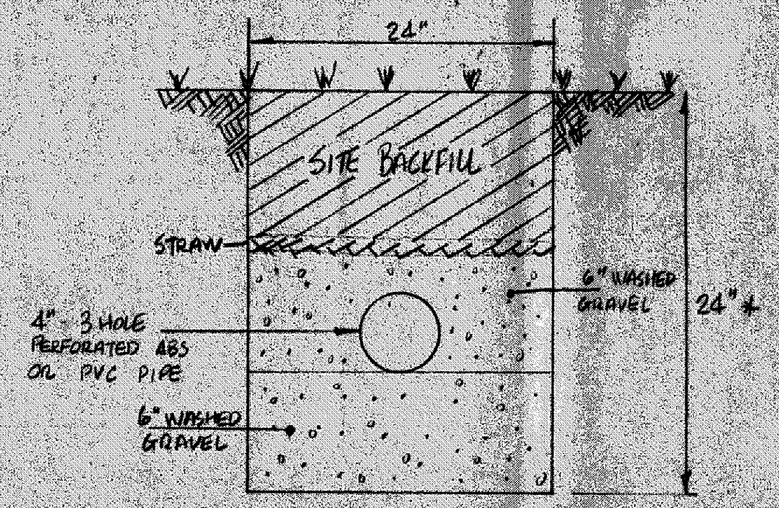

TYPICAL LEACHING TRENCH
CROSS SECTION

* THE STANDARD LEACHING TRENCH IS 24" DEEP, HOWEVER THE TRENCH CAN VARY BETWEEN 18" to 30" DEEP IF NECESSARY. GRAVEL REQUIREMENT IS STANDARD - AMOUNT OF BACKFILL WOULD VARY.

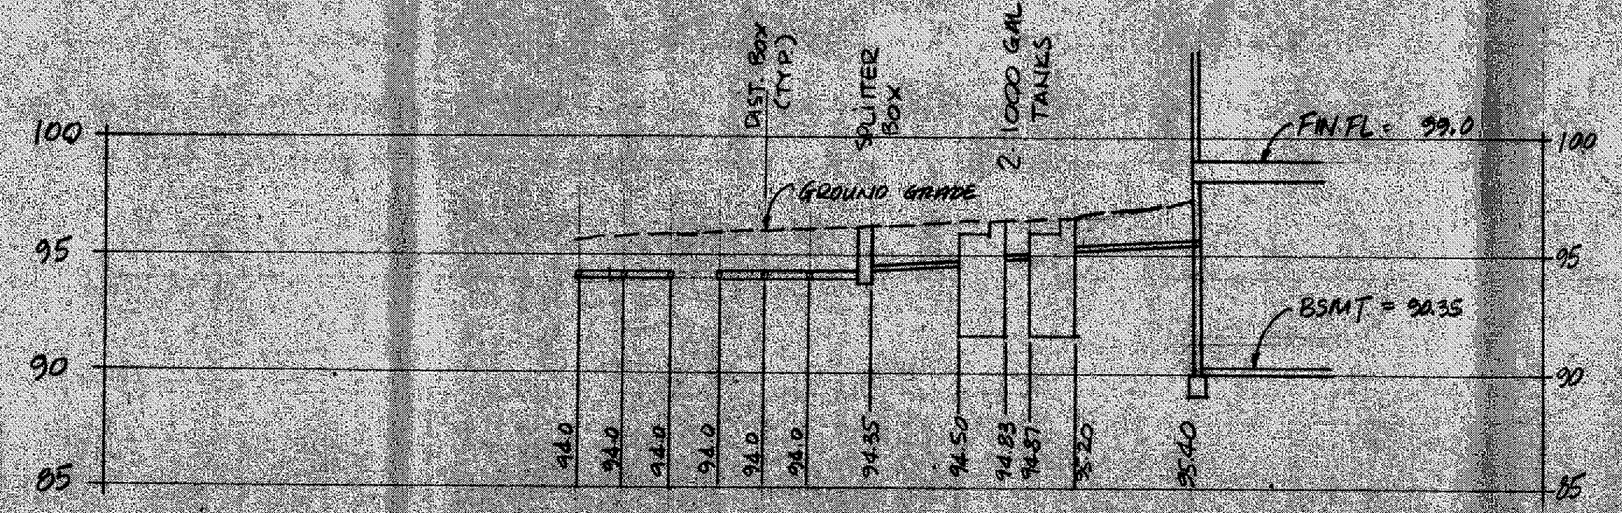

HYDRAULIC PROFILE
SCALE: 1"=20' HORIZ
1" 5' VERT

A. To be brought to finished grade
1. Septic tank manhole covers
2. Splitter box cover
3. Distribution box cover
B. No footer drains or downspouts to be discharged into septic tanks
C. All waste water to be discharged into septic tanks

Reviewed and Accepted
LAKE COUNTY GENERAL HEALTH DISTRICT
Date 5-13-96
JOEL LUCIA, R.S., M.P.H.
Health Commissioner
BY J. Lucia

SEWAGE DISPOSAL PERMIT MUST BE OBTAINED BY A LAKE COUNTY LICENSED INSTALLER BEFORE INSTALLATION IS STARTED.

Grading Plan Approved as shown and/or noted
THOMAS P. GILLES, P.E.
Lake County Engineer
By Thomas P. Gilles Date 5-23-96

LOW YIELD WATER FIXTURES REQUIRED ON ALL:
— Shower Head
— Toilet

LEGEND

EXISTING GRADES	95.8
PROPOSED GRADES	97.25
EXISTING CONTOURS	— 96 —
PROPOSED CONTOURS	96
DOWNSPOUT	
SWALE	

SITE PLAN FOR:
AMY & MICHAEL STRAWBRIDGE
4074 MIDDLE RIDGE ROAD, PERRY TWP, OH

DATE: MAY 1, 1996 SCALE 1"=20'