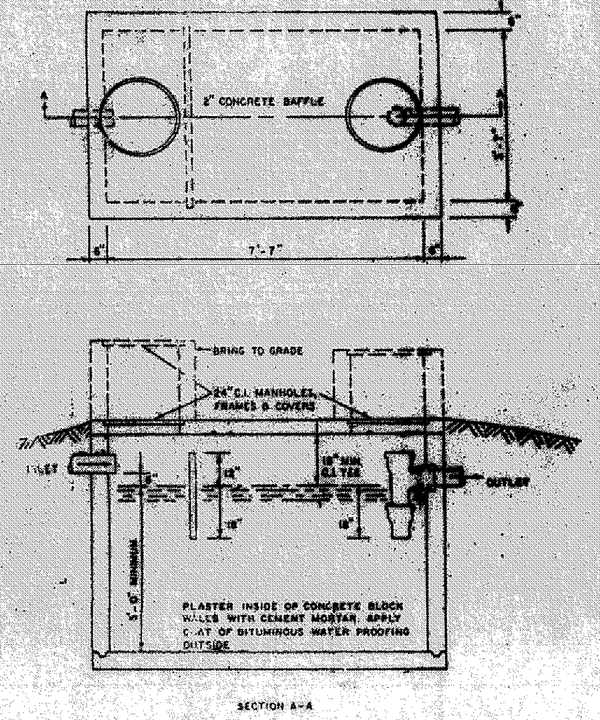

1000 GAL. SEPTIC TANK

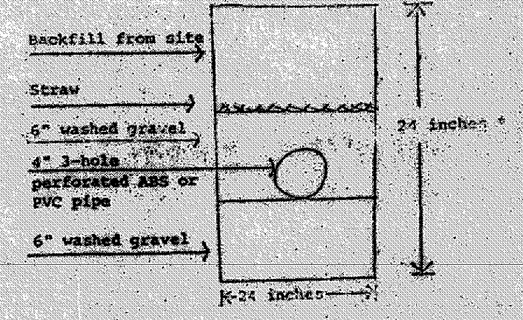

* The standard leaching trench is 24 inches deep, however the trench can vary between 18 to 30 inches deep if necessary. Gravel requirement is standard - amount of backfill would vary

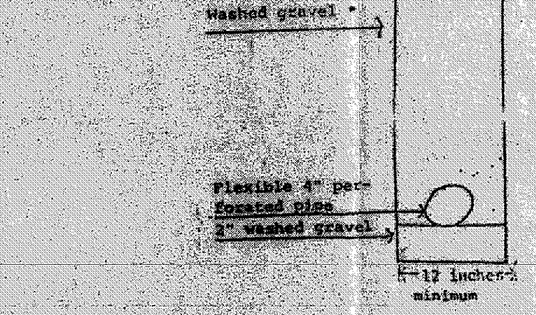

* The curtain drain must be 6 inches deeper than deepest ET/Leaching trench bottom.

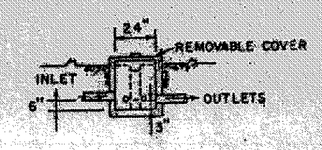

DISTRIBUTION BOX SECTION

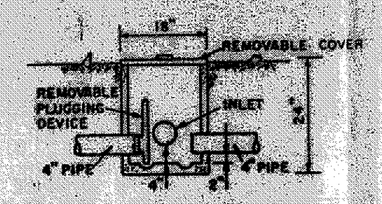

SPLITTER BOX SECTION

"I, the undersigned hereby certify that the topography shown hereon, indicated by one foot contours and elevations represents an actual field topographic survey made by me on the 27th day of August, 1992 and the 8th day of June, 1994 and that the elevations were taken at appropriate intervals and that as of that date they existed as indicated hereon."

Registered Surveyor — P.S. 6662 Reg. No.

A. To be brought to finished grade
1. Septic tank manhole covers
2. Splitter box cover
3. Distribution box cover

B. No footer drains or downspouts to be discharged into septic tanks

C. All waste water to be discharged into septic tanks

SEWAGE DISPOSAL PERMIT MUST BE OBTAINED BY A LAKE COUNTY LICENSED INSTALLER BEFORE INSTALLATION IS STARTED.

LOW YIELD WATER FIXTURES REQUIRED ON ALL:
__ Shower Head
__ Toilet

Reviewed and Accepted
LAKE COUNTY GENERAL HEALTH DISTRICT
Date 3-26-96
JOEL LUCIA, R.S., M.P.H.
Health Commissioner
By J. Lindsay

APPROVED
SIDE LINES & SET BACK
PERRY TOWNSHIP ZONING
PERMIT NO. 6269
ZONING INSPECTOR

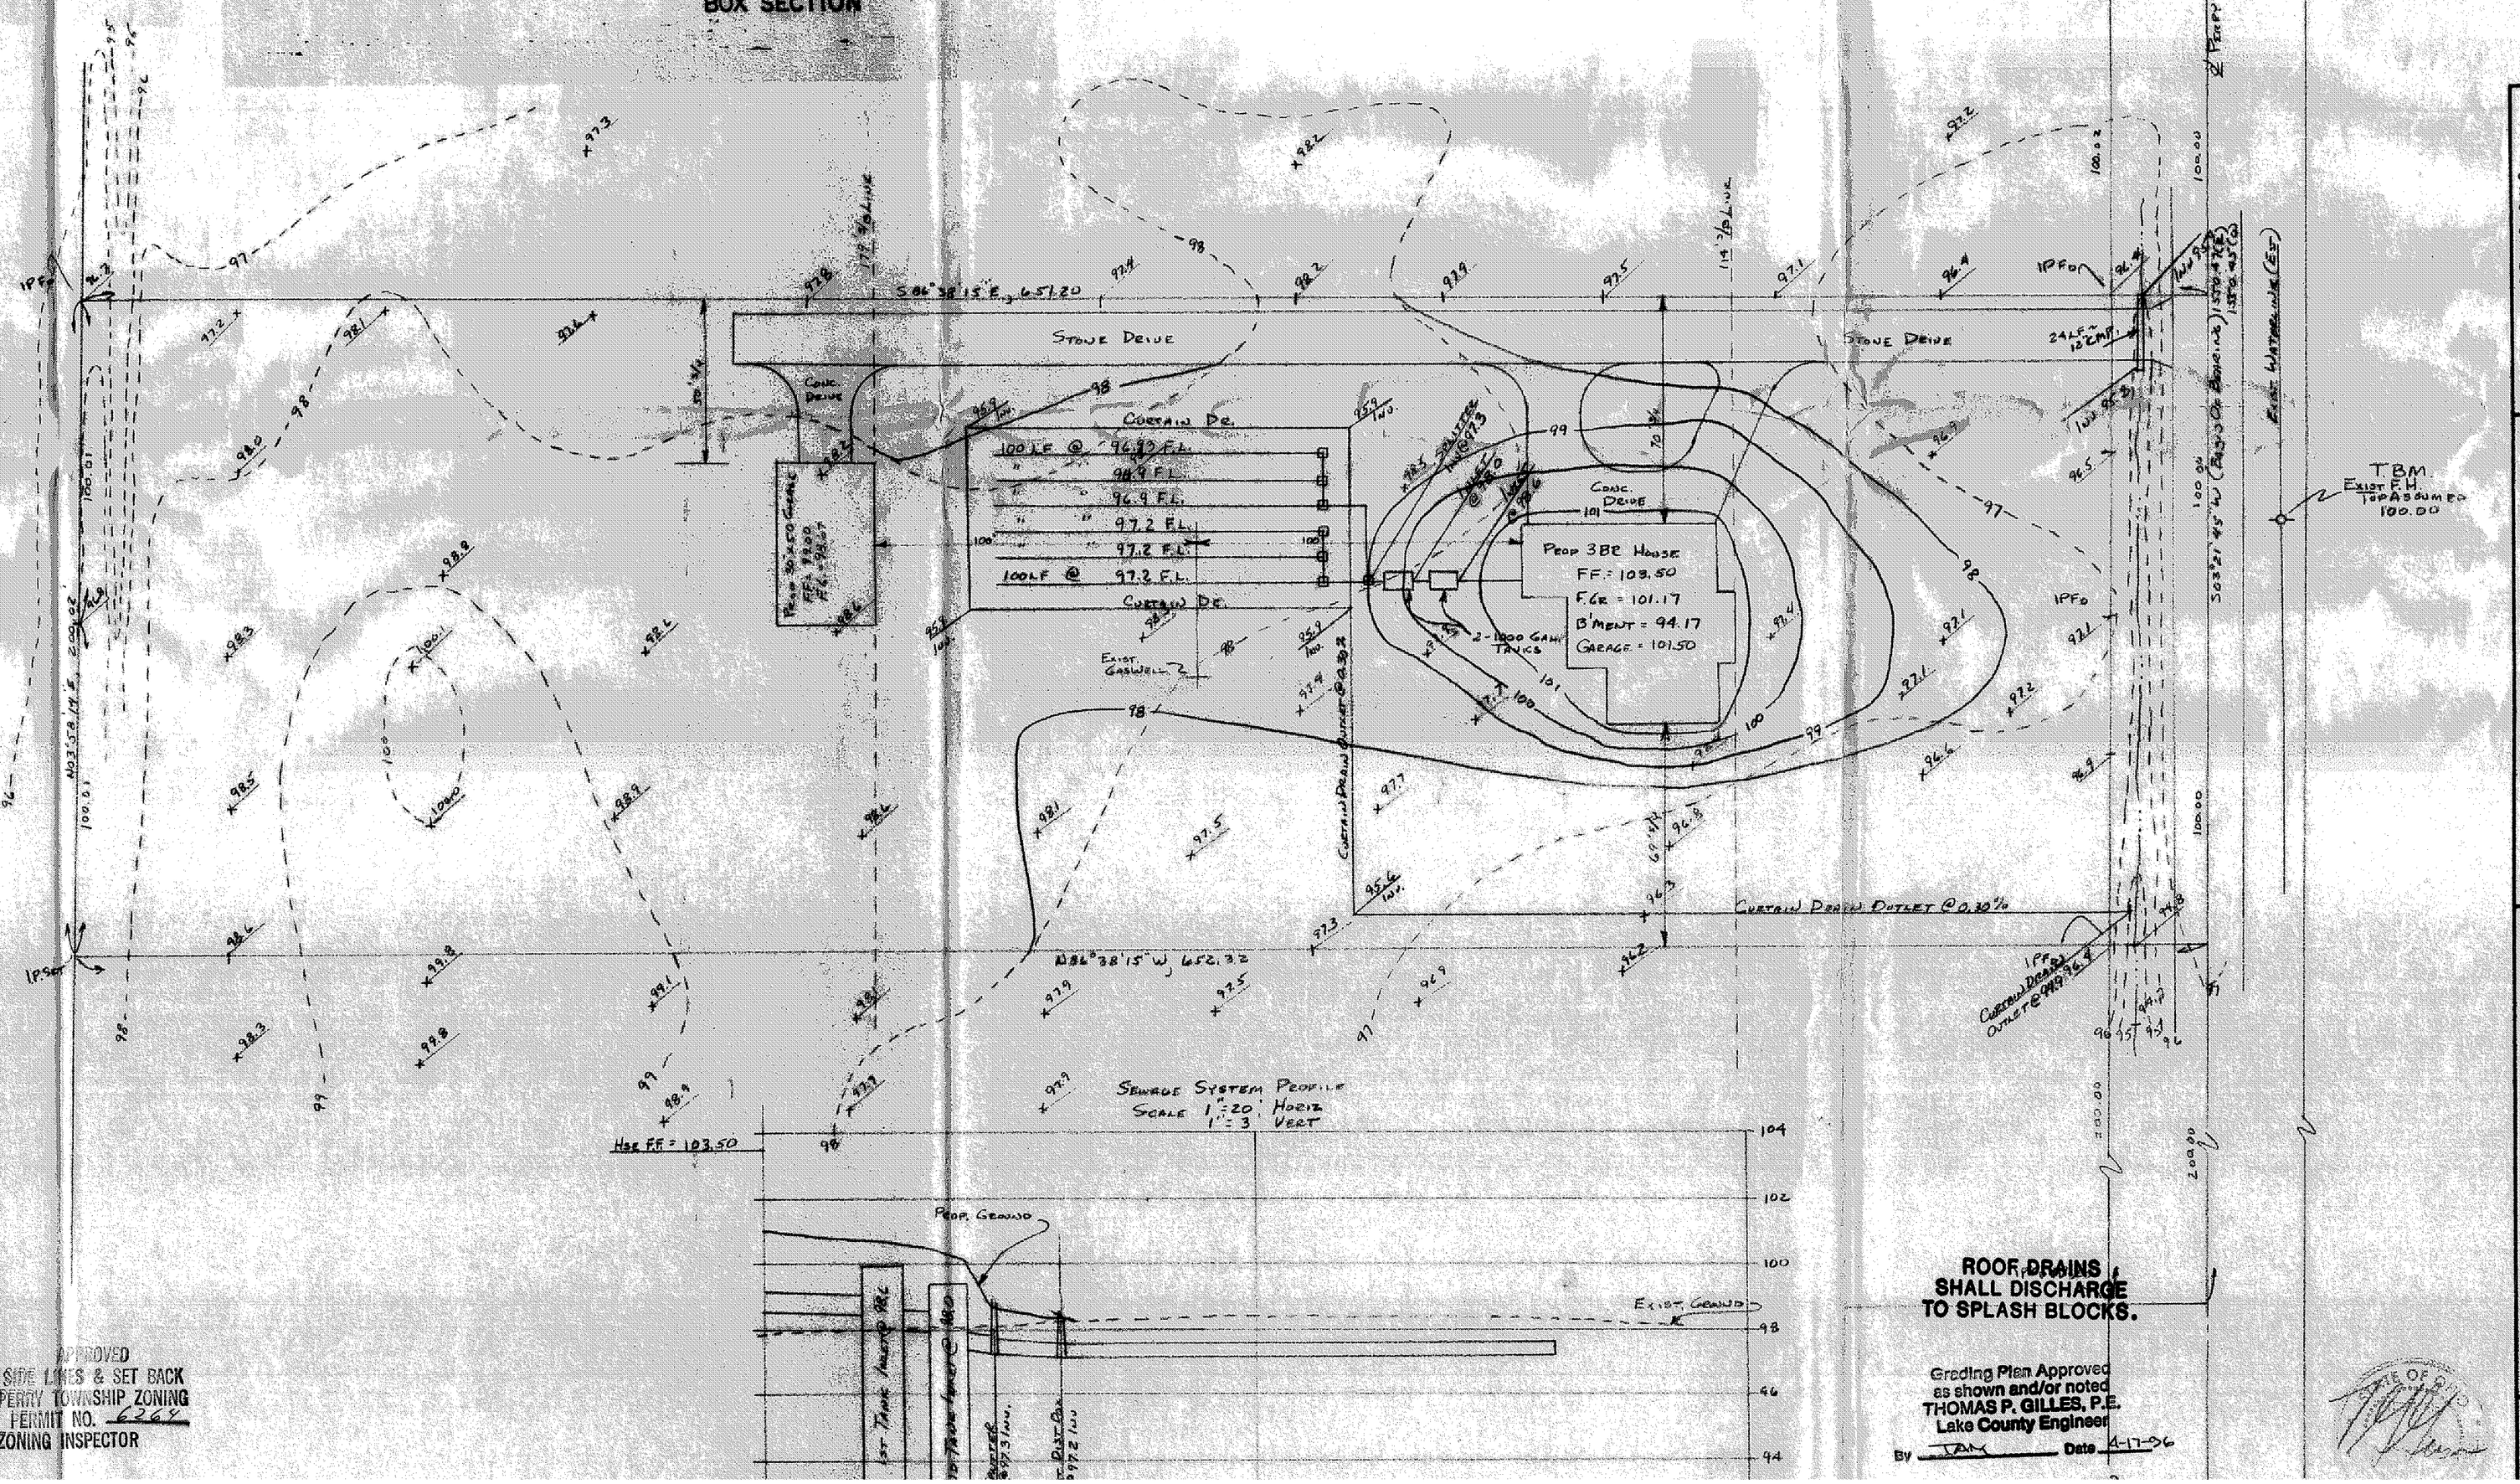

ROOF DRAINS SHALL DISCHARGE TO SPLASH BLOCKS.

Grading Plan Approved as shown and/or noted
THOMAS P. GILLES, P.E.
Lake County Engineer
By TPG Date 4-17-96

WILLIAM R. GRAY ASSOCIATES, INC.
MENTOR, OHIO 44060 946-1616

REVISIONS	
DATE	

TITLE: SITE PLAN - SEPTIC SYSTEM DESIGN - PART OF ORIGINAL LOT NO. 97 IN TOWNSHIP OF PERRY, COUNTY OF LAKE, AND STATE OF OHIO

DATE: 5.21.96 | DRAWN BY: T.G.G. | CHECKED BY: | SCALE: 1" = 30'

ALVIN STIPCIC

F NO.